

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE:

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
1A	Wood	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	9
1B	Wood	New, Reroof (Tear-Off)	A-2	Bonded Vapor or Air Barrier, Bonded Insulation(s), Bonded Roof Cover	10
1C	Wood	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	11
1D	Wood	New, Reroof (Tear-Off) or Recover	B-2	Mechanically Attached Thermal Barrier, Bonded Vapor or Air Barrier, Bonded Insulation, Bonded Roof Cover	12
1E	Wood	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	14
1F	Wood	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	15
1G	Wood	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	15
1H	Wood	New, Reroof (Tear-Off), Recover	E-1	Non-Insulated, Mechanically Attached Roof Cover	16
2A	Steel	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	17
2B	Steel	New, Reroof (Tear-Off)	A-2	Bonded Vapor or Air Barrier, Bonded Insulation(s), Bonded Roof Cover	18
2C	Steel	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	19
2D	Steel	New, Reroof (Tear-Off) or Recover	B-2	Mechanically Attached Thermal Barrier, Bonded Vapor or Air Barrier, Bonded Insulation, Bonded Roof Cover	26
2E	Steel	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	32
2F	Steel	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	38
2G	Steel	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	41
3A	Structural concrete	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	42
3B	Structural concrete	New, Reroof (Tear-Off), Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	53
3C	Structural concrete	New, Reroof (Tear-Off), Recover	C-1	Mechanically Attached Insulation, Bonded Roof Cover	60
3D	Structural concrete	New, Reroof (Tear-Off), Recover	C-2	Induction Welded Roof Cover	60
3E	Structural concrete	New, Reroof (Tear-Off), Recover	D-1	Insulated, Mechanically Attached Roof Cover	62
3F	Structural concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	62
4A	Deck with Lightweight concrete	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	63
4B	Deck with Lightweight concrete	New, Reroof (Tear-Off)	F	Non-Insulated, Bonded Roof Cover	68
5A	Cementitious wood fiber	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	70
6A	Existing gypsum	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	72
7A	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	74
7B	Steel	Recover	C-2	Induction Welded Roof Cover	78
7C	Steel	Recover	D-1	Insulated, Mechanically Attached Roof Cover	79
7D	Various	Recover	F	Non-Insulated, Bonded Roof Cover	80

The following notes apply to the systems outlined herein:

- 1 The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 2 Unless otherwise noted, fasteners and stress plates shall be as follows. Recessed plates are not for use with cement-based or gypsum-based hardboard coverboards. Fasteners shall be of sufficient length for the following engagements:

FASTENER/PLATE OPTIONS				
DECK TYPE	By	FBC	PARTS	MINIMUM ENGAGEMENT
Wood	OMG, Inc.	FL699	OMG #12 Roofgrip or OMG #14 Heavy Duty with OMG 3 in. Galvalume Steel Plates	Minimum ¾-inch plywood penetration or minimum 1-inch wood plank embedment
	SFS Group USA	FL20311	Dekfast DF-#12-PH3 or Dekfast DF-#14-PH3 with Dekfast PLT-R-3	
Steel	OMG, Inc.	FL699	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates	Minimum ¾-inch steel penetration and engage the top flute of the steel deck
	SFS Group USA	FL20311	Dekfast DF-#12-PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	
Structural Concrete	OMG, Inc.	FL699	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	Minimum 1-inch embedment. Fasteners installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions
	SFS Group USA	FL20311	Dekfast DF-#14-PH3 with Dekfast PLT-R-3	

- 3 Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- 4 Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for, or installed below, rigid insulation board for System Types B-1, C-1, C-2, D-1 or D-2, whereby fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
- 5 Preliminary insulation attachment: Unless otherwise noted, use FBC Approved roofing fasteners and plates and refer to Section 2.2.10.1.3 of [FM Loss Prevention Data Sheet 1-29](#).
- 6 Unless otherwise noted, insulation adhesive application rates are as follows.
 - ✓ Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
 - ✓ If applying hot asphalt to concrete deck, deck shall be primed with ASTM D41 primer.
 - ✓ When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.
 - ✓ The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.

INSULATION ADHESIVE REFERENCES				
By	FBC	ADHESIVE	REFERENCE	MINIMUM RATE
Altenloh, Brinck & Co US, Inc.	FL41878	TRUFAST Roofing Adhesive	TF-RA	Continuous 0.75 to 1-inch wide ribbons, 12-inch o.c.
		TRUFAST Roofing Adhesive Tanks	TF-RAT	Continuous 0.75 to 1-inch wide ribbons, 12-inch o.c. Note: Unless otherwise noted, TRUFAST Roofing Adhesive Tanks may be used in place of TRUFAST Roofing Adhesive for insulation securement, but is limited to a MDP = -315.0 psf.
Dupont de Nemours	FL720	INSTA STIK Quik Set Insulation Adhesive	Insta-Stik	Continuous 0.75 to 1-inch ribbons, 12-inch o.c.
H.B. Fuller Company	FL1800	Millennium One-Step Foamable Adhesive	M-OSFA	Continuous 0.5 to 0.75-inch ribbons, 12-inch o.c.
		Millennium PG-1 Pump Grade Adhesive	M-PG1	Continuous 0.5 to 0.75-inch ribbons, 12-inch o.c.
		Millennium PG-1 EF ECO	M-PG1-EF-ECO	Continuous 1 to 1.5-inch ribbons, 12-inch o.c.
	Note:	See Note 18 for acceptable alternates.		

INSULATION ADHESIVE REFERENCES				
BY	FBC	ADHESIVE	REFERENCE	MINIMUM RATE
ICP Construction, Inc.	FL22256	Polyset BOARD-MAX	Polyset BOARD-MAX	Continuous 3-inch ribbons, 12-inch o.c.
	FL1365	Polyset Commercial Roof Adhesive	Polyset CRA	Continuous 2.5 to 3.5-inch ribbons, 12-inch o.c.
OMG, Inc.	FL1608	OlyBond 500 Adhesive Fastener	OB500	Continuous 0.75 to 1-inch wide ribbons, 12-inch o.c. Note: Canister, PaceCart or SpotShot dispensing options.
Generic	N/A	ASTM D312, Type IV hot asphalt	HA	Full coverage at 25-30 lbs/square

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS				
ADHESIVE	COVERAGE	INSULATION	MIN. TAPERED THICKNESS (IN)	MDP (psf)
M-OSFA, M-PG1 or M-PG1-EF-ECO	12-inch o.c.	Listed polyisocyanurate	0.5	-210.0
M-OSFA, M-PG1 or M-PG1-EF-ECO	12-inch o.c.	Listed flat stock polyisocyanurate covered with tapered polyisocyanurate covered with listed gypsum-based coverboard	0.5	-360.0
Polyset CRA	12-inch o.c.	Listed polyisocyanurate	1.0	-117.5
OB500	12-inch o.c.	Rmax "Multi-Max FA3"	0.5	-45.0
		Johns Manville "ENRGY 3"	0.5	-315.0
		EnergyBoard II or Atlas "ACFoam II"	0.5	-487.5

- 8 For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of [FM Loss Prevention Data Sheet](#) 1-29.
- 9 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29, [Roofing Application Standard](#) RAS 117 and RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for Zone 2/3 enhancements.
- 10 For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with [ANSI/SPRI](#) FX-1 or [Testing Application Standard](#) TAS 105. For systems using Trufast Versa-Fast, the number of Versa-Fast Fasteners installed through the Versa-Fast Plate may be increased from the minimum noted to yield minimum required withdrawal resistance.
- 12 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, [FM Loss Prevention Data Sheet](#) 1-52 or [Testing Application Standard](#) TAS 124.
- 13 Refer to FBC 1511 for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-1 the base insulation layer is optional and for System Type C-2, D-1 or D-2, the insulation is optional. Alternatively, an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation ([Note 5](#)). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.

- 14 Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For “pre-existent” LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.
- 15 For bonded membrane applications, unless otherwise noted, refer to the following.

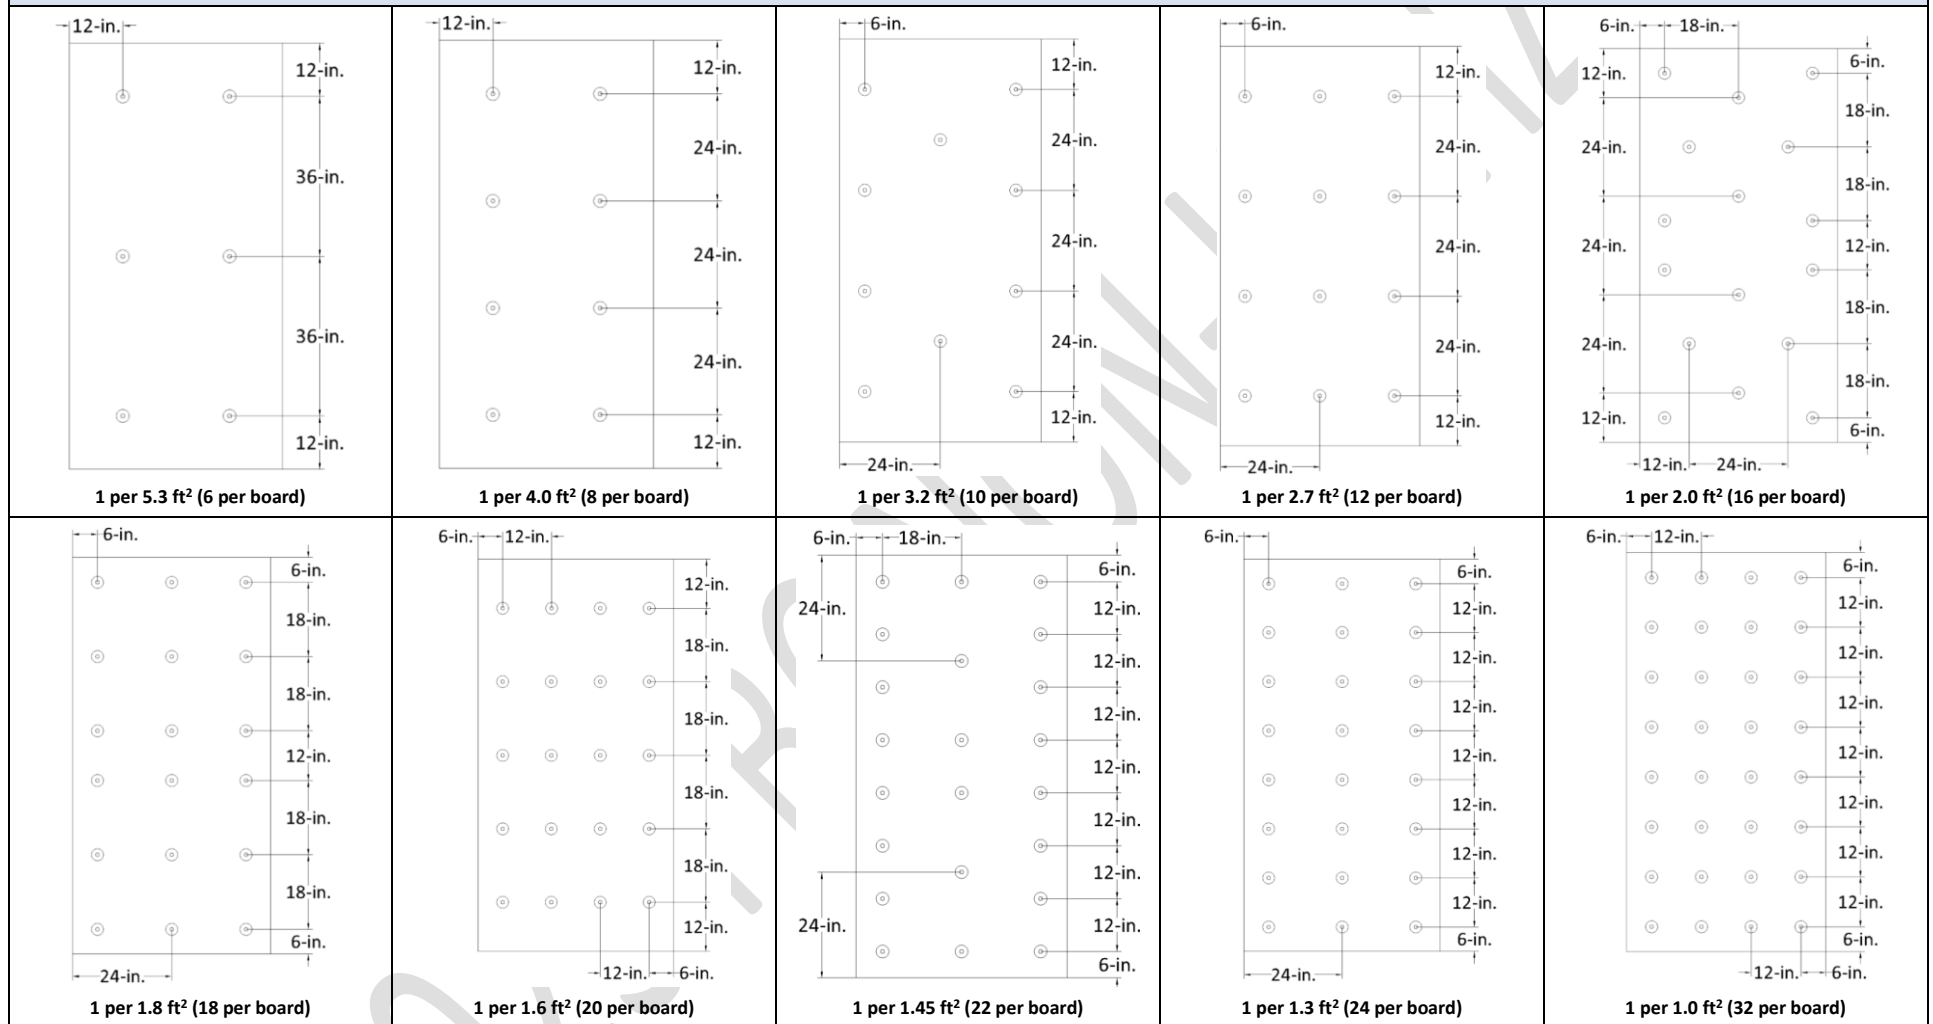
MEMBRANE / ADHESIVE COMBINATIONS				
REFERENCE	MEMBRANE	ADHESIVE	APPLICATION	RATE
BB-VB	IB PVC, IB PVC Single Ply or IB PVC Single Ply ChemGuard	IB Vertibond PVC Bonding Adhesive	Contact (both sides)	1 gal per 50 to 70 square feet, finish
BB-VB-432	IB PVC, IB PVC Single Ply or IB PVC Single Ply ChemGuard	IB Vertibond 432 Bonding Adhesive	Contact (both sides)	1 gal per 60 square feet, finish
BB-WBA	IB PVC, IB PVC Single Ply or IB PVC Single Ply ChemGuard	IB Water Borne Adhesive	Wet lay (substrate)	1 gal per 125 to 175 square feet
BB-WBA-636	IB PVC, IB PVC Single Ply or IB PVC Single Ply ChemGuard	IB Water Borne 636 Adhesive	Wet lay (substrate)	1 gal per 140 to 180 square feet
BB-SPRAY-PVC	IB PVC Single Ply or IB PVC Single Ply ChemGuard	HB Fuller Millennium Sprayable PVC Single Ply Bonding Adhesive	Contact (both sides)	1,000 square feet per canister, finish
		Note: <i>BB-Sprayable-PVC is an acceptable alternate to BB-WBA when applied to polyisocyanurate insulation, DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass Mat Roof Board.</i>		
FB-VB	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	IB Vertibond PVC Bonding Adhesive	Contact (both sides)	1 gal per 45 to 60 square feet, finish
FB-VB-432	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	IB Vertibond 432 Bonding Adhesive	Contact (both sides)	1 gal per 60 square feet, finish
FB-WBA	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	IB Water Borne Adhesive	Wet lay (substrate)	1 gal per 100 to 160 square feet
FB-WBA-636	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	IB Water Borne 636 Adhesive	Wet lay (substrate)	1 gal per 100 to 120 square feet
FB-CRA	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	ICP Adhesives Polyset CRA	Wet lay (substrate)	“Spatter pattern” at 3.75 lbs/sq.
FB-PG1	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	HB Fuller Millennium PG-1 Pump Grade Adhesive	Wet lay (substrate)	Continuous ribbons spaced as noted in tables herein.
FB-PG1-LPS	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	HB Fuller Millennium PG-1 Pump Grade Adhesive	Wet lay (substrate)	Low-Pressure Spray at 1,300 to 1,800 square feet per 5 gallon kit (0.55 to 0.75 gal/square)
FB-PG1-EF-ECO	IB PVC Fleeceback, IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	HB Fuller Millennium PG-1 EF ECO	Wet lay (substrate)	“Spatter pattern” at 0.3 gal/square.
FB-SPRAY-PVC	IB PVC Single Ply Fleeceback or IB PVC ChemGuard Fleeceback	HB Fuller Millennium Sprayable PVC Single Ply Bonding Adhesive	Contact (both sides)	800 to 900 square feet per canister, finish
		Note: <i>FB-SPRAY-PVC is an acceptable alternate to FB-WBA when applied to polyisocyanurate insulation, DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass Mat Roof Board.</i>		
SBS-TA1	Polyglass “Elastoflex S6” or “Elastoflex V”	Torch-applied		
SBS-TA2	US Ply “DuraFlex 60TG SBS Base” or “DuraFlex 90TG SBS Base, torch-applied	Torch-applied		
SBS-TA3	SOPREMA “ELASTOPHENE SP 2.2” or “SOPRALENE 180 SP 3.0”	Torch-applied		

- 15A For single-ply membranes in System Type D-1 steel deck applications, the roof membrane shall be run with its length perpendicular to the steel deck flutes. Seams shall be sealed with a min. 1.5-inch heat weld. For membrane attachment using batten-strips, batten-strip end laps shall be spliced with sufficient dimension to allow for minimum 2-fasteners at each batten-strip lap.
- 15B For System Type C-2 (induction weld), care shall be taken to ensure that the plates do not line-up with membrane seams. This condition may preclude proper induction welding of the membrane to the plates
- 16 **Thermal Barrier and/or Vapor or Air Barrier Options:**
- 16A **Structural Concrete Decks:** The lesser of the MDP listings below vs. that for the selected assembly applies.

VAPOR OR AIR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY ADHESIVE-APPLIED INSULATION					
OPTION #	PRIMER	VAPOR OR AIR BARRIER		INSULATION ADHESIVE PER TABLE 3A (NOTES 6,7,8)	MDP (PSF)
		TYPE	APPLICATION		
C-VB-1.	None	Vaproshield "SlopeShield Plus SA"	Self-adhering	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	-75.0
C-VB-2.	None	Vaproshield "BlockShield SA Plus"	Self-adhering	M-OSFA, M-PG1 or M-PG1-EF-ECO	-185.0
C-VB-3.	None	Vaproshield "BlockShield SA Plus"	Self-adhering	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	-202.5
C-VB-4.	IBarrier Primer or IBarrier Primer LV	IBarrier	Self-adhering	M-OSFA, M-PG1 or M-PG1-EF-ECO	-495.0
C-VB-5.	ASTM D41	One or two plies, FBC Approved ASTM D4601, Type II base sheet and/or ASTM D2178, Type IV or VI ply sheet	Hot asphalt	M-OSFA, M-PG1 or M-PG1-EF-ECO	-495.0
C-VB-6.	ASTM D41	Holcim "Elevate SBS Glass FR Torch" or "Elevate SBS Poly Torch Base"	Torch-applied	M-OSFA, M-PG1 or M-PG1-EF-ECO	-495.0
C-VB-7.	ASTM D41	SBS-TA1 or SBS-TA2	Torch-applied	M-OSFA, M-PG1 or M-PG1-EF-ECO	-495.0
C-VB-8.	ASTM D41	CertainTeed "Flintlastic GTA", Holcim "Elevate APP 180 FR", GAF "Ruberoid Torch Granule", Johns Manville "APPeX 4.5M", SOPREMA "ELASTOPHENE Flam GR" or "SOPRALENE Flam 180 FR GR" or "SOPRALENE Flam 250 FR GR" or Siplast "Paradiene 30 TG"	Torch-applied	Polysat CRA	-169.0
C-VB-9.	ASTM D41	CertainTeed "Flintlastic SA Cap", GAF "Liberty SBS Self-Adhering Cap Sheet", Polyglass "Elastoflex SA P" or SOPREMA "ELASTOPHENE Stick FR GR"	Self-adhering	Polysat CRA	-250.0
C-VB-10.	ASTM D41	One or two plies, FBC Approved ASTM D4601, Type II base sheet and/or ASTM D2178, Type IV or VI ply sheet	Hot asphalt	Polysat CRA	-262.5
C-VB-11.	ASTM D41	CertainTeed "Flintlastic GMS", Holcim "Elevate SBS Cap", GAF "Ruberoid 30 Granule", Johns Manville "DynaGlas", SOPREMA "ELASTOPHENE LS FR GR" or "SOPRALENE 180 FR GR" or "SOPRALENE 250 FR GR" or Siplast "Paradiene 30"	Hot asphalt	Polysat CRA	-270.0
C-VB-12.	IBarrier Primer or IBarrier Primer LV	IBarrier	Self-adhering	OB500	-307.5

17 Unless otherwise noted, insulation or coverboard attachment patterns for Type B-1, Type B-2, Type C-1 and C-2 systems are as outlined below.

INSULATION ATTACHMENT PATTERNS – 4x4 FT BOARDS				
1 per 4.0 ft² (4 per board)	1 per 3.2 ft² (5 per board)	1 per 2.7 ft² (6 per board)	1 per 2.0 ft² (8 per board)	
1 per 1.8 ft² (9 per board)	1 per 1.6 ft² (10 per board)	1 per 1.45 ft² (11 per board)	1 per 1.3 ft² (12 per board)	1 per 1.0 ft² (16 per board)

INSULATION ATTACHMENT PATTERNS – 4x8 FT BOARDS


18 The following products are interchangeable within the scope of this PEER:

ACCEPTABLE ALTERNATES				
SUB-CATEGORY	MANUFACTURER	FBC	LISTED PRODUCT HEREIN	ALTERNATE
Adhesives	H.B. Fuller Company	FL1800	Millennium One Step Foamable Adhesive (M-OSFA)	Millennium One Step Green Foamable Adhesive IB Rapid Set Insulation Adhesive
			Millennium PG-1 Pump Grade Adhesive (M-PG1 and FB-PG1-LPS)	IB Rapid Set PG Foam
			Millennium PG-1 EF ECO (M-PG1-EF-ECO and FB-PG1-EF-ECO)	Millennium PG-1 SAF Pump Grade Adhesive IB Rapid Set ECO Canister Foam
Fasteners	OMG	FL699	OMG #12 Roofgrip	IB Standard Fastener
			OMG #14 Heavy Duty	IB Heavy Duty Fastener
			OMG XHD	IB Magnum Fastener
			OMG 3 in. Galvalume Steel Plate	IB Insulation Plate
	SFS Group USA	FL20311	Dekfast DF-#12-PH3	IB DF12 Standard Fastener
			Dekfast DF-#14-PH3	IB DF14 Roofing Fastener
			Dekfast DF-#15-PH3	IB DF15 Roofing Fastener
			Dekfast PLT-R-3	IB 3" Round Metal Insulation Plate
Roofing Insulation	Atlas Roofing	FL17989	ACFoam II	IB EnergyBoard II
			ACFoam III	IB EnergyBoard III
	Hunter Panels	FL5968	H-Shield	IB Energy Board-H
			H-Shield CG	IB Energy Board CG-H
			H-Shield HD	IB HD ISO-H
	Johns Manville	FL4205	ENRGY 3	IB EnergyBoard II-J
Accessories	VaproShield, LLC	FL46829	DensDeck Prime	DensDeck StormX Prime Roof Board
			BlockShield SA Plus	IBarrier VP
			SlopeShield Plus SA	IBarrier XP

19 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads ([Note 9](#) and [Note 10](#)).

TABLE 1A: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
W-1.	Min. 7/16-inch APA rated OSB or min. 15/32-inch plywood; 2 ft span	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Additional optional layer(s) base insulation, followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
W-2.	Min. 7/16-inch APA rated OSB or min. 15/32-inch plywood; 2 ft span	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Additional optional layer(s) base insulation, followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
W-3.	Min. 7/16-inch APA rated OSB or min. 15/32-inch plywood; 2 ft span	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Additional optional layer(s) base insulation, followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*

TABLE 1B: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-2: BONDED VAPOR OR AIR BARRIER, BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Vapor or Air Barrier	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
W-4.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield	M-OSFA, M-OSGFA or M-PG1	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-OSGFA or M-PG1	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5*
W-5.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield	M-OSFA, M-OSGFA or M-PG1	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-OSGFA or M-PG1	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5*
W-6.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield	M-OSFA, M-OSGFA or M-PG1	0.5-inch H-Shield HD	M-OSFA, M-OSGFA or M-PG1	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5*
W-7.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span; blocked 4 ft o.c.	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY-3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	Additional optional layer(s) base insulation, followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
W-8.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span; blocked 4 ft o.c.	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY-3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	Additional optional layer(s) base insulation, followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
W-9.	Min. 15/32-inch, APA rated CDX, 4-ply plywood; 2 ft span; blocked 4 ft o.c.	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY-3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	Additional optional layer(s) base insulation, followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
W-10.	Min. 15/32-inch APA rated CDX 4-ply plywood	BlockShield SA Plus, self-adhering	One or more layer(s), Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	Min 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-112.5*

TABLE 1c: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)		
W-11.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 2-inch ENRGY 3	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
W-12.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 2-inch ENRGY 3	Note 2	1 per 1.6 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0
W-13.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 2-inch ENRGY 3	Note 2	1 per 1.6 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0
W-14.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG or min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
W-15.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG or min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
W-16.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG or min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
W-17.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0

TABLE 1D: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
W-18.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, OB500 or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
W-19.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, OB500 or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
W-20.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1, OB500 or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
W-21.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self-adhered	Min. 1.5-inch InsulFoam HD Composite	M-OSFA, M-PG1 or OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-45.0*
W-22.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-OSGFA or M-PG1	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5
W-23.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-OSGFA or M-PG1	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5
W-24.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	One or more layers, min. 1-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield followed by 0.5-inch H-Shield HD	M-OSFA, M-OSGFA or M-PG1	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5

TABLE 1D: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
W-25.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
W-26.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
W-27.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
W-28.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
W-29.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
W-30.	Min. 19/32-inch, APA rated CDX, 4-ply plywood; 2 ft span	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast Versa-Fast Fasteners and Plates; two (2) fasteners per plate	1 per 1.45 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self-adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0

**TABLE 1E: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)	MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)		
W-31.	Min. 19/32-inch, APA rated, Exposure 1 OSB; 2 ft span	(Optional) One or more layers, any combination	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Trufast Versa-Fast Fasteners and Plates; one (1) fastener per plate	1 per 4.0 ft ²	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-SPRAY-PVC or FB-PG1-EF-ECO	-30.0*
W-32.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	(Optional) One or more layers, any combination	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Trufast Versa-Fast Fasteners and Plates; one (1) fastener per plate	1 per 4.0 ft ²	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-SPRAY-PVC or FB-PG1-EF-ECO	-37.5*
W-33.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	(Optional) One or more layers, any combination	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG or InsulFoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
W-34.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	(Optional) One or more layers, any combination	Min. 2-inch ENRGY 3	Note 2	1 per 1.6 ft ²	✓ BB-VB or BB-WBA ✓ FB-VB or FB-WBA or FB-PG1-EF-ECO	-45.0
W-35.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	(Optional) One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG #12 Roofgrip or OMG #14 Heavy Duty with OMG 3 in. Galvalume Steel Plates or Trufast #12 DP or #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	✓ BB-VB-432	-45.0
W-36.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
W-37.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	✓ BB-VB or BB-WBA ✓ FB-VB or FB-WBA or FB-PG1-EF-ECO	-75.0
W-38.	Min. 19/32-inch, APA rated CDX plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	✓ BB-VB-432	-75.0

**TABLE 1F: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER**

System No.	Deck (Note 1)	Insulation Layer (Note 3, Note 13)	Attachment		Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Density		
W-39.	Min. 19/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	1 per 4.0 ft² (2x2 ft grid)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
W-40.	Min. 7/16-inch OSB or min. 15/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) installed through to engage wood structural members, minimum 1-1/16 inch embedment. (Field W/D ≥ 540 lbf)	Fasteners spaced max. 12-inch o.c. in rows spaced max. 48-inch o.c. <u>along wood structural members</u>	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-67.5
W-41.	Min. 7/16-inch OSB or min. 15/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) installed through to engage wood structural members, minimum 1-5/16 inch embedment. (Field W/D ≥ 585 lbf)	Fasteners spaced max. 9-inch o.c. in rows spaced max. 48-inch o.c. <u>along wood structural members</u>	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-97.5

**TABLE 1G: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Fire Barrier	Insulation (Note 3, Note 13)		Roof Cover			MDP (psf)
			Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attach	
W-42.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 12-inch x 67-inch	-30.0
W-43.	Min. 15/32-inch, APA rated CDX, 5-ply plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB #12 or IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or Dekfast DF-#12-PH3 or DF-#14-PH3 with Dekfast PLT-R-2-4B plates	In-Seam: 6-inch x 67-inch	-37.5
W-44.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 6-inch x 67-inch	-45.0
W-45.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 4-inch x 67-inch	-52.5
W-46.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates, Dekfast DF-#14-PH3 with Dekfast PLT-R-2-4B plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 3-inch x 67-inch	-60.0
W-47.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates (14 Barb)	In-Seam: 6-inch x 67-inch	-60.0
W-48.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5

**TABLE 1G: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Fire Barrier	Insulation (Note 3, Note 13)		Roof Cover			MDP (psf)
			Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attach	
W-49.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

**TABLE 1H: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE E-1: NON-INSULATED, MECHANICALLY ATTACHED ROOF COVER**

System No.	Deck (Note 1)	Fire Barrier		Roof Cover			MDP (psf)
		Type	Attach	Membrane	Fasteners (Note 11)	Attachment	
W-50.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 12-inch x 67-inch	-30.0
W-51.	Min. 15/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or Dekfast DF-#12-PH3 or DF-#14-PH3 with Dekfast PLT-R-2-4B plates	In-Seam: 6-inch x 67-inch	-37.5
W-52.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 6-inch x 67-inch	-45.0
W-53.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 4-inch x 67-inch	-52.5
W-54.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB Heavy Duty Fasteners #14 with IB 2" Galvalume Barbed Plates or OMG #14 Heavy Duty with OMG 2-in. Barbed Plates	In-Seam: 3-inch x 67-inch	-60.0
W-55.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC Single Ply ChemGuard	OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates (14 Barb)	In-Seam: 6-inch x 67-inch	-60.0
W-56.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5
W-57.	Min. 19/32-inch plywood; 2 ft span	(Optional) FBC Approved fire barrier to obtain fire classification	Loose laid	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

TABLE 2A: STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
S-1.	Min. 22 ga., type B, Grade 40 steel	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield	M-OSFA or M-PG1	(Optional) Additional layer(s) base insulation	M-OSFA or M-PG1	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
S-2.	Min. 22 ga., type B, Grade 40 steel	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield	M-OSFA or M-PG1	Additional optional layer(s) base insulation followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated-Glass Mat Roof Board	M-OSFA or M-PG1	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
S-3.	Min. 22 ga., type B, Grade 40 steel	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield	M-OSFA or M-PG1	Additional optional layer(s) base insulation followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA or M-PG1	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5
S-4.	Min. 22 ga., type B, Grade 40 steel	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield	M-OSFA or M-PG1	Additional optional layer(s) base insulation followed by 0.5-inch H-Shield HD	M-OSFA or M-PG1	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-52.5

TABLE 2b: STEEL DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-2: BONDED VAPOR OR AIR BARRIER, BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Vapor or Air Barrier	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
S-5.	Min. 22 ga., Type B, Grade 40 steel	BlockShield SA Plus, self-adhering to top deck flanges	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c., ribbons positioned atop deck flanges	Additional optional layer(s), min. 1-inch base insulation, followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
S-6.	Min. 22 ga., Type B, Grade 40 steel	BlockShield SA Plus, self-adhering to top deck flanges	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c., ribbons positioned atop deck flanges	Additional optional layer(s), min. 1-inch base insulation, followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
S-7.	Min. 22 ga., Type B, Grade 40 steel	BlockShield SA Plus, self-adhering to top deck flanges	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c., ribbons positioned atop deck flanges	Additional optional layer(s), min. 1-inch base insulation, followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0*
S-8.	Min. 22 ga., Type B, Grade 40 steel	BlockShield SA Plus, self-adhering to top deck flanges	One or more layer(s), Min. 2-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c., ribbons positioned atop deck flanges	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-90.0*

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-9.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Insta-Stik, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-10.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	Note 2	1 per 4.0 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
S-11.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	Note 2	1 per 4.0 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
S-12.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	Note 2	1 per 4.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Insta-Stik, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-13.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-14.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-15.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax or min. 2-inch ENRGY 3	Note 2	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-16.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax or min. 2-inch ENRGY 3	Note 2	1 per 2.0 ft²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
S-17.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax or min. 2-inch ENRGY 3	Note 2	1 per 2.0 ft²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
S-18.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax or min. 2-inch ENRGY 3	Note 2	1 per 2.0 ft²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-19.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-20.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-21.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-22.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-23.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-24.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-25.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-26.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
S-27.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-28.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
S-29.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime	Polyset CRA or OB500, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-LPS	-60.0
S-30.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch ACFoam HD CoverBoard	OB500, 6-inch o.c.	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
S-31.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch H-Shield HD	OB500, 6-inch o.c.	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
S-32.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime	Polyset CRA or OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0
S-33.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-60.0
S-34.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	0.5-inch ACFoam HD CoverBoard	TF-RA or TF-RAT	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-35.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	0.5-inch H-Shield HD	TF-RA or TF-RAT	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
S-36.	Min. 22 ga., Type B, Grade 33 steel	Min. 2-inch ACFoam II	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0
S-37.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-67.5
S-38.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5
S-39.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
S-40.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
S-41.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-42.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
S-43.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft²	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	Polyset CRA or OB500, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
S-44.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft²	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	Polyset CRA or OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
S-45.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax		1 per 1.3 ft²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	FB-PG1-EF-ECO	-90.0
S-46.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax		1 per 1.3 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, M-OSFA, M-PG1, OB500, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-47.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ENRGY 3		1 per 1.3 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, OB500, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-48.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax		1 per 1.3 ft²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or OB500, 6-inch o.c.	None	✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-97.5
S-49.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax		1 per 1.3 ft²	0.5-inch H-Shield HD	M-OSFA, M-PG1 or OB500, 6-inch o.c.	None	✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-97.5

TABLE 2c: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
S-50.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, M-OSFA, M-PG1, OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-51.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-52.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA or FB-PG1-LPS	-97.5
S-53.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-54.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB-432 ✓ FB-VB-432, FB-PG1-EF-ECO or FB-SPRAY-PVC	-97.5
S-55.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
S-56.	Min. 22 ga., Type B, Grade 40 steel	Min. 2-inch ACFoam II, ACFoam III or H-Shield	Dekfast DF-#14-PH3 or DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.0 ft ²	Min. 0.25-inch DensDeck Prime	Polyset BOARD-MAX	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-CRA	-105.0
S-57.	Min. 22 ga., Type B, Grade 33 steel	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-105.0

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-58.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-59.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-45.0*
S-60.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0*
S-61.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-62.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-45.0*
S-63.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO, OB500 or TF- RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0*

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-64.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1.5-inch InsulFoam HD Composite	M-OSFA, M- PG1 or OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636, FB-CRA or FB-PG1-EF- ECO	-45.0*
S-65.	Min. 22 ga., Type B, Grade 33 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1.5-inch InsulFoam HD Composite	M-OSFA, M- PG1 or OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636, FB-CRA or FB-PG1-EF- ECO	-45.0*
S-66.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0
S-67.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-45.0
S-68.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-69.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0
S-70.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-45.0
S-71.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-45.0
S-72.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-67.5
S-73.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-67.5

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-74.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-67.5
S-75.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-67.5
S-76.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACfoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-67.5
S-77.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-67.5
S-78.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-79.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-75.0
S-80.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	IBarrier Primer or IBarrier Primer LV	IBarrier, self- adhered	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0
S-81.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0
S-82.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-75.0
S-83.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	(Optional, use only if Vapor or Air Barrier installed) ASTM D41	(Optional) SBS- TA1, SBS-TA2 or SBS-TA3	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1, M-PG1- EF-ECO or TF-RA, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0

TABLE 2d: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF)
SYSTEM TYPE B-2: MECHANICALLY ATTACHED THERMAL BARRIER, BONDED VAPOR OR AIR BARRIER, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier			Primer	Vapor or Air Barrier (Note 15)	Insulation Layer(s)		Roof Cover (Note 15)	MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)			Type	Attach (Notes 6,7,8)		
S-84.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self- adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass- Mat Roof Board	M-OSFA, M- PG1 or M- PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0
S-85.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self- adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M- PG1 or M- PG1-EF-ECO, 6-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA- 636 ✓ FB-VB-432, FB-WBA, FB-WBA- 636 or FB-PG1-EF-ECO	-75.0
S-86.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	None	BlockShield SA Plus or SlopeShield Plus SA, self- adhering	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG followed by 0.5-inch H-Shield HD	M-OSFA, M- PG1 or M- PG1-EF-ECO, 6-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-75.0
S-87.	Min. 22 ga., Type B, Grade 40 steel	Min. 0.625-inch SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	None	BlockShield SA Plus, self- adhering	One or more layer(s), Min. 2-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield followed by min 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M- PG1 or M- PG1-EF-ECO, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB- WBA-636 or FB-PG1-EF-ECO	-112.5

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-88.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min 1.5 in. thick, max. 4 x 4 ft ACFoam II or Multi-Max FA3	Note 2	1 per 3.2 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-30.0*
S-89.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 3.2 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-30.0*
S-90.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 5.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-30.0*
S-91.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.625-inch DensDeck Prime	Note 2	1 per 5.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-37.5*
S-92.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 5.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-37.5*
S-93.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch InsulFoam HD Composite	Note 2	1 per 2.7 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-45.0*
S-94.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 2.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-95.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft ACFoam II or Multi-Max FA3	Note 2	1 per 4.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-96.	Min. 22 ga., Type B, Grade 33 steel	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft ENRGY 3	Note 2	1 per 4.0 ft ²	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-PG1-EF-ECO	-45.0*

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-97.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates	1 per 2.7 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-98.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-99.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board or min. 0.5-inch DensDeck Prime or SECUROCK Ultralight Coated Glass-Mat Roof Board	Note 2	1 per 4.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-100.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.625-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 5.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-101.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-102.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates or Trufast #12 DP, Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 3.2 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-103.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates or Trufast #12 DP, Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 3.2 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-104.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Dekfast DF-#12-PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 2.7 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-105.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Dekfast DF-#12-PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3	1 per 2.7 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-106.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Note 2 or Trufast #12 DP, Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 4.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-107.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	Note 2 or Trufast #12 DP, Trufast #14 HD or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 4.0 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-108.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.625-inch DEXcell FA Glass Mat Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plates or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 5.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
S-109.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.625-inch DEXcell FA Glass Mat Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3, OMG XHD with OMG 3 in. Galvalume Steel Plates or Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 5.3 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
S-110.	Min. 22 ga., Type B, Grade 33 steel	(Optional when using 1.5-inch top insulation) One or more layers, any combination	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG or InsulFoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-45.0
S-111.	Min. 22 ga., Type B, Grade 33 steel	(Optional when using 1.5-inch top insulation) One or more layers, any combination	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	Note 2	1 per 1.6 ft ²	None	✓ FB-PG1-LPS	-45.0
S-112.	Min. 22 ga., Type B, Grade 33 steel	(Optional when using 2-inch top insulation) One or more layers, any combination	Min. 2-inch ENRGY 3	Note 2	1 per 1.6 ft ²	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-PG1-EF-ECO	-45.0

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-113.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination	Min. 0.25-inch DEXcell FA Glass-Mat Roof Board	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates or Trufast #12 DP, #14HD or #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.6 ft ²	None	✓ BB-VB-432	-45.0
S-114.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DensDeck Prime	Note 2	1 per 1.8 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
S-115.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Note 2	1 per 1.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
S-116.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
S-117.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-60.0
S-118.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	Note 2	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-60.0
S-119.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#12-PH3, Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Ribbed Galvalume Plate (Flat)	1 per 2.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-60.0
S-120.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 2.0 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3 , Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-121.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.8 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-67.5
S-122.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plates	1 per 1.8 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5
S-123.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5
S-124.	Min. 22 ga., Type B, Grade 40 steel	(Optional when using 1.5-inch top insulation) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-75.0
S-125.	Min. 22 ga., Type B, Grade 40 steel	(Optional when using 1.5-inch top insulation) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	None	✓ FB-PG1-LPS	-75.0
S-126.	Min. 22 ga., Type B, Grade 40 steel	(Optional when using 2-inch top insulation) One or more layers, any combination, loose laid	Min. 2-inch ENRGY 3	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-PG1-EF-ECO	-75.0
S-127.	Min. 22 ga., Type B, Grade 40 steel	One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate or Trufast #14 HD or #15 EHD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	None	✓ BB-VB-432	-75.0
S-128.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.6 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-75.0

TABLE 2E: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
S-129.	Min. 22 ga., Type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Dekfast DF-#15-PH3 with Dekfast PLT-R-3 or OMG Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
S-130.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, loose laid	Min. 0.625-inch DensDeck Prime	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-90.0
S-131.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-112.5
S-132.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	Note 2	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-112.5
S-133.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-127.5
S-134.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.5-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-127.5
S-135.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	OMG #12 Roofgrip, OMG #14 Heavy Duty or OMG XHD with OMG 3 in. Galvalume Steel Plate	1 per 1.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-142.5*
S-136.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 2-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.0 ft ²	SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-150.0
S-137.	Min. 22 ga., type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board (max. 4x4 ft)	Trufast #15 EHD with Trufast 3" Metal Insulation Plates	1 per 1.0 ft ² (16 per 4x4 ft board)	SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-157.5

TABLE 2F: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

System No.	Deck (Note 1)	Insulation Layer (Note 3, Note 13)	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
SFS ISOWELD INDUCTION WELD SYSTEMS:							
S-138.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	36	24 (staggered)	IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
S-139.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	36	24 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
S-140.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	12	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
S-141.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	12	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
S-142.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	36	24 (staggered)	IB PVC or IB PVC Single Ply Chemguard (min. 60-mil) induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-143.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	24 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-144.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	24 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
S-145.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	18 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
S-146.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	18 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
S-147.	Min. 22 ga., type B, Grade 40 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	6	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
S-148.	Min. 22 ga., type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#12-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	6	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
TRUFAST IW PVC PLATE INDUCTION WELD SYSTEMS:							
S-149.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-45.0
S-150.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-45.0
S-151.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0

TABLE 2F: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

System No.	Deck (Note 1)	Insulation Layer (Note 3 , Note 13)	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
S-152.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
S-153.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
S-154.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 4.0 ft ² (8 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
		The roof insulation boards are placed with the 8 ft. board dimension oriented parallel to the steel deck ribs with adjacent boards offset along their 8 ft. dimension by 12 in., to stagger the fastener/plate fastening pattern					
S-155.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 3.2 ft ² (10 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-67.5
		The roof insulation boards are placed with the 8 ft. board dimension oriented parallel to the steel deck ribs with adjacent boards offset along their 4 ft. dimension by 12 in., to stagger the fastener/plate fastening pattern					
S-156.	Min. 18 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
S-157.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
S-158.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
S-159.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
S-160.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
S-161.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	36	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-82.5
S-162.	Min. 22 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 2.7 ft ² (12 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-82.5
		The roof insulation boards are placed with the 8 ft. board dimension oriented perpendicular to the steel deck ribs with adjacent boards offset along their 4 ft. dimension by 12 in., to stagger the fastener/plate fastening pattern					

TABLE 2F: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

System No.	Deck (Note 1)	Insulation Layer (Note 3 , Note 13)	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
S-163.	Min. 18 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
S-164.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
S-165.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
S-166.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
S-167.	Min. 18 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
S-168.	Min. 20 ga., Type B, Grade 33 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
S-169.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
S-170.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
		The roof insulation boards are placed with the 8 ft. board dimension oriented perpendicular to the steel deck ribs with adjacent boards offset along their 4 ft. dimension by 12 in., to stagger the fastener/plate fastening pattern					
S-171.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-120.0
		The roof insulation boards are placed with the 8 ft. board dimension oriented parallel to the steel deck ribs with adjacent boards offset along their 4 ft. dimension by 6 in., to stagger the fastener/plate fastening pattern					
S-172.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #15 EHD Fastener with Trufast IW PVC Plate	36	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-150.0
S-173.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination, min. 1.5-inch thick	Trufast #15 EHD Fastener with Trufast IW PVC Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-150.0
		The roof insulation boards are placed with the 8 ft. board dimension oriented parallel to the steel deck ribs with adjacent boards offset along their 4 ft. dimension by 6 in., to stagger the fastener/plate fastening pattern					

TABLE 2G: STEEL DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier and/or Insulation (Note 3 , Note 13)		Roof Cover (Note 15A)			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attach	
S-174.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 18-inch x 67-inch	-30.0
S-175.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	Trufast #14 HD with Trufast 2" Barbed Metal Seam Plates	In-Seam: 12-inch x 67-inch	-30.0
S-176.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 12-inch x 67-inch	-45.0
S-177.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates (14 Barb)	In-Seam: 12-inch x 67-inch	-45.0
S-178.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates, Trufast #14 HD with Trufast 2" Barbed Metal Seam Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates (14 Barb)	In-Seam: 6-inch x 67-inch	-60.0
S-179.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 67-inch	-67.5
S-180.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC Single Ply or IB PVC Single Ply ChemGuard	OMG XHD Fasteners through OMG Polymer Batten Strips	In-Field: 6-inch x 96-inch	-67.5
S-181.	Min. 22 ga., Type B, Grade 80 steel	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	IB XHD #15 Roofing Fastener with IB 2-3/8" Barbed Seam Plates, Dekfast DF-#15-PH3 with Dekfast PLT-2-3/8-6B plates, OMG XHD with OMG 2-3/8 XHD Barbed Stress Plates or Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plates	In-Seam: 6-inch x 31-inch	-127.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply		
INSULATION IN HOT ASPHALT:									
C-1.	Min. 2,500 psi structural concrete	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5	
C-2.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or Multi-Max FA3	HA	(Optional) Additional layers(s) of base insulation	HA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0	
C-3.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or Multi-Max FA3	HA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-255.0	
C-4.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	HA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	HA	None	✓ BB-VB, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-375.0	
C-5.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	HA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	HA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-375.0	
C-6.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	HA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	HA	None	✓ BB-VB-432	-495.0	
INSULATION IN INSTA-STIK:									
C-7.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	Insta-Stik	(Optional) Additional layers(s) of base insulation	Insta-Stik	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5	
C-8.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5	
C-9.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	Insta-Stik	(Optional) Additional layers(s) of base insulation	Insta-Stik	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0	
C-10.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0	

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-11.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Insta-Stik	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Insta-Stik	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0
INSULATION IN MILLENNIUM ONE STEP FOAMABLE ADHESIVE OR MILLENNIUM PG-1 PUMP GRADE ADHESIVE:								
C-12.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 1.5-inch InsulFoam HD Composite	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-102.5
C-13.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-135.0
C-14.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	(Optional) Additional layer(s) of base insulation	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
C-15.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
C-16.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1	None	BB-VB-432	-232.5
C-17.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-232.5
C-18.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
C-19.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG or Styrofoam Brand Roofmate or min. 1.5-inch Styrofoam Brand Highload 60 or Plazamate	M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-257.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-20.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1	None	BB-VB-432	-257.5
C-21.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-257.5
C-22.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-257.5
C-23.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	0.5-inch H-Shield HD	M-OSFA, M-PG1	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-257.5
C-24.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-257.5
C-25.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG or Styrofoam Brand Roofmate or min. 1.5-inch Styrofoam Brand Highload 60 or Plazamate	M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-267.5
C-26.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-267.5
C-27.	Min. 2,500 psi structural concrete	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1	(Optional) Additional layer(s) of base insulation	M-OSFA, M-PG1	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-327.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-28.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	M-OSFA, M-PG1, 6-inch o.c.	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, 6-inch o.c.	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-405.0
C-29.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-490.0
C-30.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-657.5
C-31.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	M-OSFA, M-PG1, 4-inch o.c.	None	M-OSFA, M-PG1, 4-inch o.c.	None	FB-PG1-EF-ECO	-670.0
C-32.	Min. 2,500 psi structural concrete	Min. 1.5-inch H-Shield CG	M-OSFA, M-PG1, 4-inch o.c.	(Optional) Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, 4-inch o.c.	None	BB-VB-432	-670.0
INSULATION IN MILLENNIUM PG-1 EF ECO ADHESIVE:								
C-33.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-135.0
C-34.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Insulation: Min. 1.5-inch thick Insulfoam I, VIII or IX Coverboard: Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-187.5
C-35.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
C-36.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-37.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-PG1-EF-ECO	None	BB-VB-432	-232.5
C-38.	Min. 2,500 psi structural concrete	Min. 1.5-inch Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
C-39.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-247.5
C-40.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-247.5
C-41.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-PG1-EF-ECO	None	BB-VB-432	-247.5
C-42.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-PG1-EF-ECO	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-247.5
C-43.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	0.5-inch ACFoam HD CoverBoard	M-PG1-EF-ECO	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-247.5
C-44.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	0.5-inch H-Shield HD	M-PG1-EF-ECO	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-247.5
C-45.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-247.5
C-46.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam III	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-267.5
C-47.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1.5-inch ACFoam III	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-267.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-48.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam III	M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation	M-PG1-EF-ECO	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-327.5
C-49.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1-EF-ECO, 6-inch o.c.	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-PG1-EF-ECO, 6-inch o.c.	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-405.0
C-50.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	M-PG1-EF-ECO, 4-inch o.c.	None	M-PG1-EF-ECO, 4-inch o.c.	None	✓ FB-PG1-EF-ECO	-670.0
C-51.	Min. 2,500 psi structural concrete	Min. 1.5-inch H-Shield CG	M-PG1-EF-ECO, 4-inch o.c.	None	M-PG1-EF-ECO, 4-inch o.c.	None	✓ BB-VB-432	-670.0
C-52.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	M-PG1-EF-ECO, 4-inch o.c.	Min. 0.5-inch DensDeck Prime	M-PG1-EF-ECO, 4-inch o.c.	None	✓ BB-VB or BB-VB-432 ✓ FB-WBA-636 or FB-PG1-EF-ECO	-827.5
C-53.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	M-PG1-EF-ECO, 4-inch o.c.	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO, 4-inch o.c.	None	✓ BB-VB-432 or BB-WBA ✓ FB-PG1-EF-ECO	-827.5
INSULATION IN OLYBOND 500:								
C-54.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
C-55.	Min. 2,500 psi structural concrete	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA1 or SBS-TA2	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
C-56.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	Min. 1.5-inch InsulFoam HD Composite	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-102.5
C-57.	Min. 2,500 psi structural concrete	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-58.	Min. 2,500 psi structural concrete	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA1 or SBS-TA2	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0
C-59.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	OB500	(Optional) Additional layer(s) of base insulation	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-150.0
C-60.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-150.0
C-61.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DensDeck Prime	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-257.5
C-62.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-267.5
C-63.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	0.5-inch ACFoam HD CoverBoard	OB500	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-257.5
C-64.	Min. 2,500 psi structural concrete	(Optional) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	0.5-inch H-Shield HD	OB500	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-257.5
C-65.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DensDeck Prime	OB500	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-282.5
C-66.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield CG	OB500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OB500	None	✓ BB-VB, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-WBA or FB-WBA-636	-322.5
C-67.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-322.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-68.	Min. 2,500 psi structural concrete	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	OB500	(Optional) Additional layer(s) of base insulation	OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-327.5
C-69.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3 or H-Shield CG	OB500	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OB500	None	✓ BB-VB-432 or BB-SPRAY-PVC ✓ FB-VB-432, FB-PG1-EF-ECO or FB-SPRAY-PVC	-390.0
C-70.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	OB500, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-490.0
C-71.	Min. 2,500 psi structural concrete	Min. 2-inch Multi-Max FA3 or Tapered Thermaroof-3	OB500, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-630.0
C-72.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-657.5
INSULATION IN ICP ADHESIVES POLYSET CRA:								
C-73.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
C-74.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
C-75.	Min. 2,500 psi structural concrete	Min. 1-inch IB Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	None	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-250.0
C-76.	Min. 2,500 psi structural concrete	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-77.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-257.5

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-78.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-267.5
C-79.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	None	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-80.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-282.5
C-81.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, H-Shield or H-Shield CG	Polyset CRA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	Polyset CRA	None	✓ BB-VB-432 or BB-SPRAY-PVC ✓ FB-VB-432, FB-PG1-EF-ECO or FB-SPRAY-PVC	-300.0
C-82.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	Polyset CRA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-322.5
C-83.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	Polyset CRA, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-490.0
C-84.	Min. 2,500 psi structural concrete	(Optional) Min. 2-inch Multi-Max FA3 or Tapered Thermaroof-3	Polyset CRA, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-PG1-EF-ECO	-530.0
C-85.	Min. 2,500 psi structural concrete	Min. 2-inch Multi-Max FA3 or Tapered Thermaroof-3	Polyset CRA, 6-inch o.c.	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA or FB-PG1-LPS	-625.0
C-86.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA or FB-PG1-LPS	-657.5
INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:								
C-87.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-88.	Min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
C-89.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
C-90.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
C-91.	Min. 2,500 psi structural concrete	Min. 1-inch IB Multi-Max FA3, UltraMax	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	None	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-250.0
C-92.	Min. 2,500 psi structural concrete	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-93.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-267.5
C-94.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	None	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-95.	Min. 2,500 psi structural concrete	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-96.	Min. 2,500 psi structural concrete	Min. 0.25-inch DensDeck Prime or DEXcell FA Glass Mat Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-490.0

TABLE 3A: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

 SEE [NOTE 16A](#) FOR VAPOR OR AIR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer(s)		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-97.	Min. 2,500 psi structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	N/A	SBS-TA1 or SBS-TA2	FB-CRA or FB-PG1-LPS	-657.5
INSULATION IN TRUFAST ROOFING ADHESIVE:								
C-98.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	TF-RA	0.5-inch ACFoam HD CoverBoard	TF-RA	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-165.0
C-99.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	TF-RA	0.5-inch H-Shield HD	TF-RA	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-165.0
C-100.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	TF-RA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-195.0
C-101.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	TF-RA	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	TF-RA	None	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-195.0
C-102.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3, H-Shield or H-Shield CG	TF-RA	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-195.0
C-103.	Min. 2,500 psi structural concrete	Min. 1.5-inch ENRGY 3	TF-RA	(Optional) Additional layers(s) of base insulation	TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-262.5
C-104.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, H-Shield or H-Shield CG	TF-RA	(Optional) Additional layers(s) of base insulation	TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-272.5
C-105.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II	TF-RA	None	N/A	None	✓ FB-PG1-EF-ECO	-322.5
C-106.	Min. 2,500 psi structural concrete	Min. 1.5-inch H-Shield CG	TF-RA	None	N/A	None	✓ BB-VB-432	-322.5

TABLE 3B: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-107.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-108.	Min. 2,500 psi structural concrete	Min. 2-inch ENRGY 3	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-109.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or OB500	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
C-110.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or OB500	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
C-111.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-112.	Min. 2,500 psi structural concrete	Min. 2-inch ENRGY 3	Note 2	1 per 2.9 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-113.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*

TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-114.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
C-115.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0*
C-116.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	Polyset BOARD-MAX, Polyset CRA, M-OSFA, M-PG1, M-PG1-EF-ECO, OB500 or TF-RA	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-117.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
C-118.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
C-119.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 3.2 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-120.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*
C-121.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-45.0*

TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-122.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0*
C-123.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
C-124.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-52.5
C-125.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
C-126.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime	Polyset CRA or OB500, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0
C-127.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch ACFoam HD CoverBoard	OB500, 6-inch o.c.	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
C-128.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch H-Shield HD	OB500, 6-inch o.c.	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
C-129.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime	Polyset CRA or OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0

TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-130.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-60.0
C-131.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	0.5-inch ACFoam HD CoverBoard	TF-RA or TF-RAT	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
C-132.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	0.5-inch H-Shield HD	TF-RA or TF-RAT	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
C-133.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-60.0
C-134.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-67.5
C-135.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-67.5
C-136.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
C-137.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
C-138.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	None	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0

TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-139.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
C-140.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	Polyset CRA or OB500, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
C-141.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	Note 2	1 per 1.6 ft ²	Min. 0.25-inch SECUROCK Gypsum Fiber Roof Board	Polyset CRA or OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0
C-142.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, M-OSFA, M-PG1, OB500, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-143.	Min. 2,500 psi structural concrete	Min. 2-inch ENRGY 3	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, OB500, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-144.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or OB500, 6-inch o.c.	None	✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-97.5
C-145.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	0.5-inch H-Shield HD	M-OSFA, M-PG1 or OB500, 6-inch o.c.	None	✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-97.5
C-146.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA, M-OSFA, M-PG1, OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5

TABLE 3b: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Cap Ply	
C-147.	Min. 2,500 psi structural concrete	Min. 2-inch ENRGY 3	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, OB500, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-148.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-149.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Multi-Max FA3 or UltraMax	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-150.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Additional layer(s) base insulation	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB-432 ✓ FB-VB-432, FB-PG1-EF-ECO or FB-SPRAY-PVC	-97.5
C-151.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-97.5
C-152.	Min. 2,500 psi structural concrete	Min. 2-inch ACFoam II, ACFoam III or H-Shield	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.0 ft ²	Min. 0.25-inch DensDeck Prime	Polyset BOARD-MAX	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-CRA	-105.0
C-153.	Min. 2,500 psi structural concrete	Min. 1.5-inch ACFoam II, ENRGY 3 or H-Shield	Trufast #14 HD with Trufast 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	TF-RA or TF-RAT, 6-inch o.c.	None	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-EF-ECO or FB-SPRAY-PVC	-105.0

TABLE 3c: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation (Note 3, Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 11)	Attach (Note 17)	Base Ply	Cap Ply	
C-154.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 1.5 in. thick, max. 4 x 4 ft ACFoam II or Multi-Max FA3	Note 2	1 per 3.2 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-30.0
C-155.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	Note 2	1 per 2.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
C-156.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft ACFoam II or Multi-Max FA3	Note 2	1 per 4.0 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
C-157.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 2 in. thick, max. 4 x 4 ft ENRGY 3	Note 2	1 per 4.0 ft ²	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-PG1-EF-ECO	-45.0
C-158.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield, H-Shield CG, Insulfoam HD Composite or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-75.0
C-159.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 2-inch ENRGY 3	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	None	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA or FB-PG1-EF-ECO	-75.0
C-160.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 0.25-inch DensDeck Prime	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	None	✓ FB-PG1-LPS	-75.0
C-161.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates or Trufast #14 HD or Trufast ¾" Concrete Spike with Trufast 3" Metal Insulation Plate	1 per 1.3 ft ²	None	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-75.0
C-162.	Min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OMG #14 Heavy Duty or OMG CD-10 with OMG 3 in. Galvalume Steel Plates	1 per 1.3 ft ²	SBS-TA1 or SBS-TA2	FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-75.0

TABLE 3d: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

System No.	Deck (Note 1)	Insulation Layer (Note 3 , Note 13)	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
SFS ISOWELD INDUCTION WELD SYSTEMS:							
C-163.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	36	24 (staggered)	IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-37.5
C-164.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	12	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
C-165.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	36	24 (staggered)	IB PVC or IB PVC Single Ply Chemguard (min. 60-mil) induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
C-166.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	24 (staggered)	IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-52.5
C-167.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	24	18 (staggered)	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-82.5
C-168.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch	Dekfast DF-#14-PH3 or Dekfast DF-#15-PH3 with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC)	60	6	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
TRUFAST IW PVC PLATE INDUCTION WELD SYSTEMS:							
C-169.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	60	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-45.0
C-170.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	48	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
C-171.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 4.0 ft² (8 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
C-172.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 3.2 ft² (10 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-67.5
C-173.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
C-174.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	36	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-82.5
C-175.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 2.7 ft² (12 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-82.5

TABLE 3D: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

System No.	Deck (Note 1)	Insulation Layer (Note 3, Note 13)	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
C-176.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
C-177.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
C-178.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 2.0 ft ² (16 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
C-179.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 1.8 ft ² (18 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-120.0
C-180.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick, prelim. attach	Trufast #14 HD Fastener with Trufast IW PVC Plate	36	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-150.0
C-181.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 1.3 ft ² (24 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-172.5
C-182.	Min. 2,500 psi structural concrete	One or more layers, any combination, min. 1.5-inch thick	Trufast #14 HD Fastener with Trufast IW PVC Plate	1 per 1.0 ft ² (32 parts per 4x8 ft board)		IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-217.5

TABLE 3E: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER

System No.	Deck (Note 1)	Insulation (Note 3, Note 13)		Roof Cover			MDP (psf)
		Type	Attach (Note 5)	Membrane	Fasteners (Note 11)	Attach	
C-183.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 18-inch x 67-inch	-30.0
C-184.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 12-inch x 67-inch	-45.0
C-185.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 12-inch x 67-inch	-45.0
C-186.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC Single Ply ChemGuard	OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 67-inch	-60.0
C-187.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 67-inch	-67.5
C-188.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC Single Ply	OMG CD-10 Fasteners through OMG Polymer Batten Strips	In-Field: 6-inch x 96-inch	-67.5
C-189.	Min. 2,500 psi structural concrete	One or more layers, any combination	Prelim. attach	IB PVC or IB PVC Single Ply	Dekfast DF-#14-PH3 with Dekfast PLT-2-3/8-6B plates or OMG CD-10 Fasteners with OMG 2-3/8 XHD Barbed Stress Plates	In-Seam: 6-inch x 31-inch	-127.5

TABLE 3F: STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Roof Cover (Note 15)	MDP (psf)
C-190.	Min. 2,500 psi structural concrete	BB-WBA-636, FB-WBA-636, FB-PG1-LPS or FB-PG1-EF-ECO	-327.5
C-191.	Min. 2,500 psi structural concrete	BB-WBA, FB-WBA or FB-CRA	-512.5
C-192.	Min. 2,500 psi structural concrete	FB-PG1-EF-ECO	-707.5

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
CELCore (FL2037):								
LWC-1	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-90.0
LWC-2	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	0.5-inch ACfoam HD CoverBoard	M-OSFA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-90.0
LWC-3	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	0.5-inch H-Shield HD	M-OSFA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-90.0
LWC-4	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-217.5
LWC-5	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	0.5-inch ACfoam HD CoverBoard	M-OSFA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-217.5
LWC-6	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA	0.5-inch H-Shield HD	M-OSFA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-217.5
LWC-7	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACfoam II, ACfoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
LWC-8	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	0.5-inch ACFoam HD CoverBoard	M-OSFA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
LWC-9	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound and surfaced with Celcore Sanded Bonding Surface	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	0.5-inch H-Shield HD	M-OSFA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
LWC-10	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-240.0
LWC-11	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	0.5-inch ACFoam HD CoverBoard	M-OSFA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-240.0
LWC-12	Structural concrete	Min. 300 psi, min. 2-inch Celcore MF Cellular Concrete; treated with Celcore PVA Curing Compound	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-PG1	0.5-inch H-Shield HD	M-OSFA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-240.0
LWC-13	Structural concrete	Min. 420 psi, min. 2-inch Celcore MF Cellular Concrete	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-405.0
LWC-14	Structural concrete	Min. 420 psi, min. 2-inch Celcore MF Cellular Concrete	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ FB-PG1-EF-ECO	-405.0
LWC-15	Structural concrete	Min. 420 psi, min. 2-inch Celcore MF Cellular Concrete	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ FB-PG1-EF-ECO	-405.0

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
LWC-16	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
LWC-17	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
LWC-18	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
LWC-19	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete.	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-222.5
ELASTIZELL (NOA 23-0817.05):								
LWC-20	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
LWC-21	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
LWC-22	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
LWC-23	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
LWC-24	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	Min. 1.5-inch ACFoam II	OB500	(Optional) Additional layers base insulation	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
LWC-25	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5-inch ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-225.0
LWC-26	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch ACFoam HD CoverBoard	OB500	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-225.0

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
LWC-27	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch H-Shield HD	OB500	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-225.0
MEARLCRETE (FL13492):								
LWC-28	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
LWC-29	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch Insulfoam XIV	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
LWC-30	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layers base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
LWC-31	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-240.0
PRE-EXISTENT CELLULAR LWC (Note 14):								
LWC-32	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance ≥ 149 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB, BB-VB-432, BB-WBA, BB-WBA-636 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
LWC-33	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance ≥ 149 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB, BB-VB-432 or BB-SPRAY-PVC ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
LWC-34	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance ≥ 149 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0
LWC-35	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance ≥ 149 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-60.0

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
LWC-36	Min. 22 ga., Type BV, Grade 50 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 132 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3, EnergyGuard Polyiso Insulation or H-Shield	M-OSFA, M-PG1 or M-PG1-EF-ECO	(Optional) Additional layer(s) base insulation followed by	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ FB-PG1-EF-ECO	-67.5
LWC-37	Min. 22 ga., Type BV, Grade 50 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 132 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.5-inch DensDeck Prime	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB, BB-VB-432 or BB-WBA ✓ FB-VB, FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-67.5
LWC-38	Min. 22 ga., Type BV, Grade 50 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 132 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432 or BB-WBA ✓ FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-67.5
LWC-39	Min. 22 ga., Type BV, Grade 50 steel, 6 ft span	Min. 400-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 132 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-67.5
LWC-40	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Min. 0.5-inch DensDeck Prime	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB, BB-VB-432 or BB-WBA ✓ FB-VB, FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-120.0
LWC-41	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB-432 or BB-WBA ✓ FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-120.0
LWC-42	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-120.0

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)	MDP (psf)
			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
LWC-43	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	Min. 0.5-inch DensDeck Prime	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB, BB-VB-432 or BB-WBA ✓ FB-VB, FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-127.5
LWC-44	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB-432 or BB-WBA ✓ FB-VB-432, FB-WBA or FB-PG1-EF-ECO	-127.5
LWC-45	Min. 22 ga., Type BV, Grade 40 steel, 5 ft span	Min. 380-psi pre-existent cellular LWC. <i>To qualify the LWC, a Trufast FM-90 base ply fastener shall yield withdrawal resistance $\geq$ 135 lbf when tested per Note 11.</i>	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO or TF-RA, 6-inch o.c.	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-127.5

TABLE 4B: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Treatment	Roof Cover (Note 15)	MDP (psf)
CELCORE (FL2037):					
LWC-46	Min. 22 ga., Type B, Grade 33 steel, 6 ft span	Min. 200 psi, min. 2-inch Celcore Cellular Concrete or min. 350 psi, min. 2-inch Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-60.0
LWC-47	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Celcore S-1 Deck Preparation Min. 350 psi, min. 2-inch Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-67.5
LWC-48	Min. 22 ga., Type B, Grade 33 steel, 5 ft span	Min. 200 psi, min. 2-inch Celcore Cellular Concrete	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-75.0
LWC-49	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Celcore S-1 Deck Preparation Min. 310 psi, min. 2-inch Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-82.5
LWC-50	Min. 22 ga., Type BV, Grade 40 steel, 6 ft span	Celcore S-1 Deck Preparation Min. 460 psi, min. 2-inch Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-90.0
LWC-51	Min. 22 ga., Type B, Grade 33 steel, 4 ft span	Min. 200 psi, min. 2-inch Celcore Cellular Concrete	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-90.0

TABLE 4B: LIGHTWEIGHT CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Treatment	Roof Cover (Note 15)	MDP (psf)
LWC-52	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-135.0
LWC-53	Structural concrete	Min. 200 psi, min. 2-inch Celcore Cellular Concrete	Celcore Curing Compound	✓ BB-WBA or BB-WBA-636 ✓ FB-WBA, FB-WBA-636 or FB-CRA	-242.5
LWC-54	Structural concrete	Min. 225 psi, min. 2-inch Celcore MF Cellular Concrete	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-262.5
LWC-55	Structural concrete	Min. 400 psi, min. 2-inch Celcore Cellular Concrete (no EPS) or min. 350 psi, min. 2-inch Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture	Celcore Curing Compound	✓ FB-PG1-EF-ECO	-300.0
ELASTIZELL (NOA 23-0817.05):					
LWC-56	Min. 22 ga., Type BV, Grade 33 steel, 6 ft span	Min. 430 psi, min. 2-inch Elastizell Lightweight Insulating Concrete with Zell-Crete Fibers	None	✓ FB-PG1-EF-ECO	-52.5
LWC-57	Min. 22 ga., Type BV, Grade 33 steel, 5 ft span	Zell Bonding Agent applied to steel deck. Min. 200 psi, min. 2.5-inch Elastizell Lightweight Insulating Concrete	None	✓ FB-PG1-EF-ECO	-60.0
LWC-58	Min. 22 ga., Type BV, Grade 33 steel, 4 ft span	Min. 550 psi, min. 3-inch Elastizell Lightweight Insulating Concrete (no EPS)	None	✓ FB-PG1-EF-ECO	-90.0
LWC-59	Min. 22 ga., Type BV, Grade 33 steel, 6 ft span	Min. 700 psi, min. 2-inch Elastizell Lightweight Insulating Concrete	None	✓ FB-PG1-EF-ECO	-105.0
LWC-60	Structural concrete	Min. 200 psi, min. 2-inch Range II Elastizell Lightweight Insulating Concrete	None	✓ BB-WBA or BB-WBA-636 ✓ FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-242.5
LWC-61	Structural concrete	Min. 400 psi, min. 2-inch Elastizell Lightweight Insulating Concrete (no EPS)	None	✓ FB-PG1-EF-ECO	-487.5
MEARLCRETE (FL13492):					
LWC-62	Min. 22 ga., Type BV, Grade 33 steel, 5 ft span	Min. 200 psi, min. 2-inch Mearlcrete	None	✓ FB-PG1-EF-ECO	-75.0
LWC-63	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	None	✓ FB-PG1-EF-ECO	-152.5
LWC-64	Structural concrete	Min. 200 psi, min. 2-inch Mearlcrete	None	✓ BB-WBA or BB-WBA-636 ✓ FB-WBA, FB-WBA-636 or FB-CRA	-242.5

TABLE 5A: CEMENTITIOUS WOOD FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
CWF-1.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	(Optional) Additional layer(s) of base insulation and/or Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
CWF-2.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Additional layer(s) of base insulation followed by 0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
CWF-3.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Additional layer(s) of base insulation followed by 0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-75.0
CWF-4.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-PG1-LPS or FB-PG1-EF-ECO	-90.0
CWF-5.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-90.0
CWF-6.	3-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1 or M-PG1-EF-ECO	0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-90.0
CWF-7.	2-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 6-inch o.c.	Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fibrer Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 6-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-127.5
CWF-8.	2-inch Tectum Plank; 4 ft span	Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	(Optional) Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fibrer Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-350.0
CWF-9.	2-inch Tectum Plank; 4 ft span	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-350.0
CWF-10.	2-inch Tectum Plank; 4 ft span	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield or H-Shield CG	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	0.5-inch H-Shield HD	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-350.0

TABLE 5A: CEMENTITIOUS WOOD FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
CWF-11.	2-inch Tectum Plank; 4 ft span	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1, M-PG1-EF-ECO, TF-RA or TF-RAT, 4-inch o.c.	None	N/A	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-455.0
CWF-12.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	Min. 1.5-inch ACFoam II or Multi-Max FA3	OB500	(Optional) Additional layer(s) of base insulation	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
CWF-13.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-45.0
CWF-14.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	OB500	0.5-inch ACFoam HD CoverBoard	OB500	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0
CWF-15.	Existing Tectum Plank or Tectum LS Plank (re-roof only)	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	OB500	0.5-inch H-Shield HD	OB500	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-45.0
CWF-16.	Existing Fibroplank (re-roof only)	Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	(Optional) Additional layer(s) of base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
CWF-17.	Existing Fibroplank (re-roof only)	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
CWF-18.	Tectum Plank	Min. 1-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG	Polyset CRA	(Optional) Additional layer(s) of base insulation	N/A	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-75.0
CWF-19.	Tectum Plank	(Optional) Min. 1.5-inch ACFoam II, ACFoam III, H-Shield or H-Shield CG or min. 1.5 pcf Insulfoam II or min. 2.0 pcf Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-EF-ECO	-75.0
CWF-20.	Tectum Plank	(Optional if Coverboard installed) One or more layer(s), min. 1-inch ACFoam II, ACFoam III, GAF EnergyGuard Polyiso Insulation, ENRGY 3, H-Shield or Multi-Max FA3	Polyset BOARD-MAX	Min. 0.25-inch DensDeck Prime	Polyset BOARD-MAX	✓ BB-VB or BB-WBA ✓ FB-VB, FB-WBA, FB-CRA or FB-PG1-LPS	-75.0

TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
INSULATION IN MILLENNIUM ONE STEP FOAMABLE ADHESIVE, MILLENNIUM PG-1 PUMP GRADE ADHESIVE OR MILLENNIUM PG-1 EF ECO:							
G-1.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	(Optional) Additional layers(s) of base insulation	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
G-2.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECURock Gypsum-Fiber Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
G-3.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432	-202.5
G-4.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	Min. 0.25-inch SECURock Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-202.5
G-5.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	0.5-inch AC Foam HD CoverBoard	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-202.5
G-6.	Existing gypsum deck	Min. 1.5-inch AC Foam II, AC Foam III, ENRGY 3, EnergyGuard Polyiso Insulation, H-Shield, H-Shield CG or Multi-Max FA3	M-OSFA, M-PG1 or M-PG1-EF-ECO	0.5-inch H-Shield HD	M-OSFA, M-PG1 or M-PG1-EF-ECO	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-202.5
INSULATION IN OLYBOND 500:							
G-7.	Existing gypsum deck	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECURock Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
G-8.	Existing gypsum deck	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECURock Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-112.5
G-9.	Existing gypsum deck	Min. 1.5-inch AC Foam II	OB500	(Optional) Additional layers(s) of base insulation	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-112.5

TABLE 6A: GYPSUM DECKS - REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
G-10.	Existing gypsum deck	(Optional) Min. 1.5-inch ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-112.5
G-11.	Existing gypsum deck	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch ACFoam HD CoverBoard	OB500	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-112.5
G-12.	Existing gypsum deck	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch H-Shield HD	OB500	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-112.5
INSULATION IN ICP ADHESIVES POLYSET CRA:							
G-13.	Existing gypsum deck	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
G-14.	Existing gypsum deck	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layers(s) of base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
G-15.	Existing gypsum deck	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-245.0
INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:							
G-16.	Existing gypsum deck	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield	Polyset BOARD-MAX	(Optional) Additional layers(s) of base insulation	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
G-17.	Existing gypsum deck	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, Multi-Max FA3	Polyset BOARD-MAX	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-LPS	-245.0
G-18.	Existing gypsum deck	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, Multi-Max FA3	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ FB-PG1-EF-ECO	-245.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
INSULATION IN HOT ASPHALT:							
R-1.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch Insulfoam IX	HA (back-mopped)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA (back-mopped)	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-202.5
R-2.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch ACFoam II or Multi-Max FA3	HA	(Optional) Additional layers(s) of base insulation	HA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
R-3.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II or Multi-Max FA3	HA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	HA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-255.0
INSULATION IN MILLENNIUM ONE STEP FOAMABLE ADHESIVE OR MILLENNIUM PG-1 PUMP GRADE ADHESIVE:							
R-4.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	(Optional) Additional layers(s) of base insulation	M-OSFA, M-PG1	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0
R-5.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-OSFA, M-PG1	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
R-6.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-OSFA, M-PG1	✓ BB-VB-432	-232.5
R-7.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-OSFA, M-PG1	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-232.5
R-8.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	0.5-inch ACFoam HD CoverBoard	M-OSFA, M-PG1	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
R-9.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-OSFA, M-PG1	0.5-inch H-Shield HD	M-OSFA, M-PG1	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
INSULATION IN MILLENNIUM PG-1 EF ECO ADHESIVE:							
R-10.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	(Optional) Additional layers(s) of base insulation	M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-215.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
R-11.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	M-PG1-EF-ECO	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-232.5
R-12.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	M-PG1-EF-ECO	✓ BB-VB-432	-232.5
R-13.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	Min. 0.25-inch SECUROCK Ultralight Coated Glass-Mat Roof Board	M-PG1-EF-ECO	✓ BB-VB-432 ✓ FB-PG1-EF-ECO	-232.5
R-14.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	0.5-inch ACFoam HD CoverBoard	M-PG1-EF-ECO	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
R-15.	Existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch ACFoam II, ENRGY 3 or Multi-Max FA3	M-PG1-EF-ECO	0.5-inch H-Shield HD	M-PG1-EF-ECO	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-232.5
INSULATION IN OLYBOND 500:							
R-16.	Existing asphaltic BUR or modified bitumen	Min. 1-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-52.5
R-17.	Existing asphaltic BUR or modified bitumen	Min. 2-inch Insulfoam IX	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0
R-18.	Existing asphaltic BUR or modified bitumen	Min. 1.5-inch ACFoam II	OB500	(Optional) Additional layers(s) of base insulation	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
R-19.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-120.0
R-20.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch ACFoam HD CoverBoard	OB500	✓ BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-120.0
R-21.	Existing asphaltic BUR or modified bitumen	(Optional) Min. 1.5-inch ACFoam II	OB500	0.5-inch H-Shield HD	OB500	✓ BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-PG1-EF-ECO	-120.0
INSULATION IN ICP ADHESIVES POLYSET CRA:							
R-22.	Existing smooth-surface asphaltic BUR or smooth- or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset CRA	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
R-23.	Existing smooth-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-222.5
R-24.	Existing smooth-surface modified bitumen	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-222.5
R-25.	Existing smooth-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-222.5
R-26.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-250.0
R-27.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-257.5
R-28.	Existing smooth-surface asphaltic BUR	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-262.5
R-29.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-262.5

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
R-30.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-262.5
R-31.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-267.5
R-32.	Existing granule-surface modified bitumen	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset CRA	(Optional) Additional layer(s) base of base insulation	Polyset CRA	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-270.0
R-33.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset CRA	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Polyset CRA	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-270.0
INSULATION IN ICP ADHESIVES POLYSET BOARD-MAX:							
R-34.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch DensDeck or SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636 or FB-CRA	-180.0
R-35.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	One or more layers, min. 1.5-inch Insulfoam IX	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ FB-PG1-LPS or FB-PG1-EF-ECO	-180.0
R-36.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	Min. 1-inch Multi-Max FA3, UltraMax	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-250.0
R-37.	Existing smooth-surface asphaltic BUR or granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.5-inch DensDeck Prime	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA or FB-PG1-LPS	-232.5
R-38.	Existing smooth-surface asphaltic BUR	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-262.5
R-39.	Existing smooth-surface asphaltic BUR	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-262.5
R-40.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA or FB-WBA-636	-267.5

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation and roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)	MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)		
R-41.	Existing granule-surface modified bitumen	Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG	Polyset BOARD-MAX	(Optional) Additional layer(s) base of base insulation	Polyset BOARD-MAX	✓ BB-VB, BB-VB-432, BB-WBA or BB-WBA-636 ✓ FB-VB, FB-VB-432, FB-WBA, FB-WBA-636, FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-270.0
R-42.	Existing granule-surface modified bitumen	(Optional) Min. 1-inch ACFoam II, ACFoam III, ENRGY 3, H-Shield, H-Shield CG, Multi-Max FA3, UltraMax	Polyset BOARD-MAX	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Polyset BOARD-MAX	✓ FB-CRA, FB-PG1-LPS or FB-PG1-EF-ECO	-270.0

TABLE 7B: STEEL - RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation Layer	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
SFS ISOWELD INDUCTION WELD SYSTEMS:							
R-43.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	60	12	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-45.0
R-44.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	48	12	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-67.5
R-45.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	60	6	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-90.0
R-46.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, preliminarily fastened (Note 5)	SFS Dekfast DF-#12-PC-SQ with SFS <i>isoweld</i> ® PVC Plates (FI-P-6.8-PVC) are fastened through to purlins	48	9	IB PVC or IB PVC Single Ply or IB PVC Single Ply Chemguard induction welded with SFS <i>isoweld</i> ® 3000 tool.	-97.5
TRUFAST IW PVC PLATE INDUCTION WELD SYSTEMS:							
R-47.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	60	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-45.0

TABLE 7B: STEEL - RECOVER
SYSTEM TYPE C-2: INDUCTION WELDED ROOF COVER

(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation Layer	Attachment			Roof Cover (Note 15B)	MDP (psf)
			Fasteners (Note 11)	Row Spacing (inch)	Fastener Spacing (inch)		
R-48.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	48	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-60.0
R-49.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 72-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	72	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-75.0
R-50.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	36	12	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-82.5
R-51.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	60	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-90.0
R-52.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 48-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	48	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-112.5
R-53.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.060-in.), 50 ksi steel purlins spaced max. 36-inch o.c.	One or more layers, any combination, min. 1.5-inch thick, prelim attach	Trufast #12 Purlin Fastener with Trufast IW PVC Plate fastened through to purlins	36	6	IB PVC Single Ply (min. 60-mil) or IB PVC Single Ply Chemguard induction welded with Trufast Induction Welding Tool and Magnets.	-150.0

TABLE 7c: STEEL – RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED ROOF COVER
(All areas where the existing metal panels do not lay flush on the underlying purlin shall have a 0.25-inch diameter pilot hole pre-drilled into the panel prior to driving the Purlin Fastener into the purlin.)

System No.	Substrate (Note 1)	Insulation	Roof Cover			MDP (psf)
			Membrane	Fasteners (Note 11)	Attach	
R-54.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily attached (Note 5)	IB PVC or IB PVC Single Ply	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 18-inch x 60-inch	-30.0
R-55.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily attached (Note 5)	IB PVC or IB PVC Single Ply	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 12-inch x 60-inch	-45.0
R-56.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 60-inch o.c.	One or more layers, any combination, preliminarily attached (Note 5)	IB PVC or IB PVC Single Ply	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 6-inch x 60-inch	-67.5
R-57.	Existing standing seam or lap seam metal roof covers having min. 16 gauge (0.0598 inch), 50 ksi steel purlins spaced max. 30-inch o.c.	One or more layers, any combination, preliminarily attached (Note 5)	IB PVC or IB PVC Single Ply	SFS Dekfast DF-#12-PC-SQ with Dekfast PLT-2-3/8-6B plates, through to engage steel purlins	In-Seam: 6-inch x 30-inch	-127.5

TABLE 7d: RECOVER APPLICATIONS
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new roof cover when installed atop the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 , Note 12)	Roof Cover (Note 15)	MDP (psf) ^A
R-58.	Existing fully adhered, smooth-surface asphalt built-up or smooth/sand-surface APP modified bitumen roof or granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	FB-PG1, 12-inch o.c.	-67.5
R-59.	Existing fully adhered, smooth/sand-surface APP modified bitumen roof	FB-CRA	-75.0
R-60.	Existing fully adhered, smooth-surface asphalt built-up or smooth/sand-surface APP modified bitumen roof or granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	FB-PG1, 6-inch o.c.	-112.5
R-61.	Existing mechanically fastened base sheet with fully adhered, granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	FB-PG1, 6-inch o.c. or FB-CRA	-112.5
R-62.	Existing fully adhered, smooth-surface, asphalt built-up roof	FB-CRA	-222.5
R-63.	Existing fully adhered, granule-surface SBS or APP modified bitumen roof	FB-CRA	-250.0
R-64.	Existing fully adhered, smooth-surface asphalt built-up or smooth/sand-surface APP or SBS modified bitumen roof or granule-surface asphalt-built-up or granule-surface APP or SBS modified bitumen roof	FB-PG1-EF-ECO	-530.0