


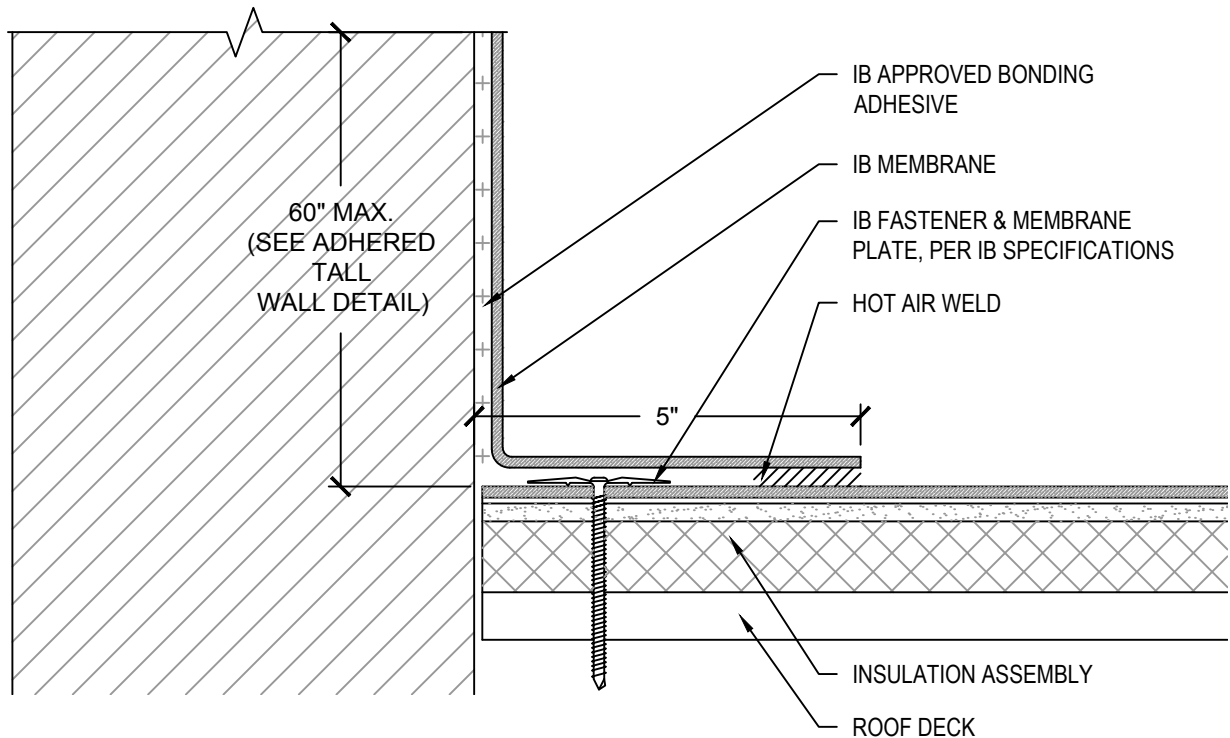

**NOTES:**

1. SINGLE COURSE WALL FLASHING MAXIMUM HEIGHTS:
  - A. 60" ABOVE ROOF DECK.
  - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO ADHERED TALL WALL DETAIL.
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. SEALANTS AND CAULKING REQUIRE PERIODIC OWNER MAINTENANCE.
4. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**


**NEW CONSTRUCTION - FULLY ADHERED**

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

**FULLY ADHERED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS**

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, OR 7/16" OSB.

|                                         |                                         |                                      |
|-----------------------------------------|-----------------------------------------|--------------------------------------|
| Scale:<br>NTS                           | Detail Name:<br><br><b>Adhered Wall</b> | Detail Number:<br><br><b>WD - 01</b> |
| Submitted By:<br>Address:<br>Telephone: |                                         | Project:<br>Address:                 |

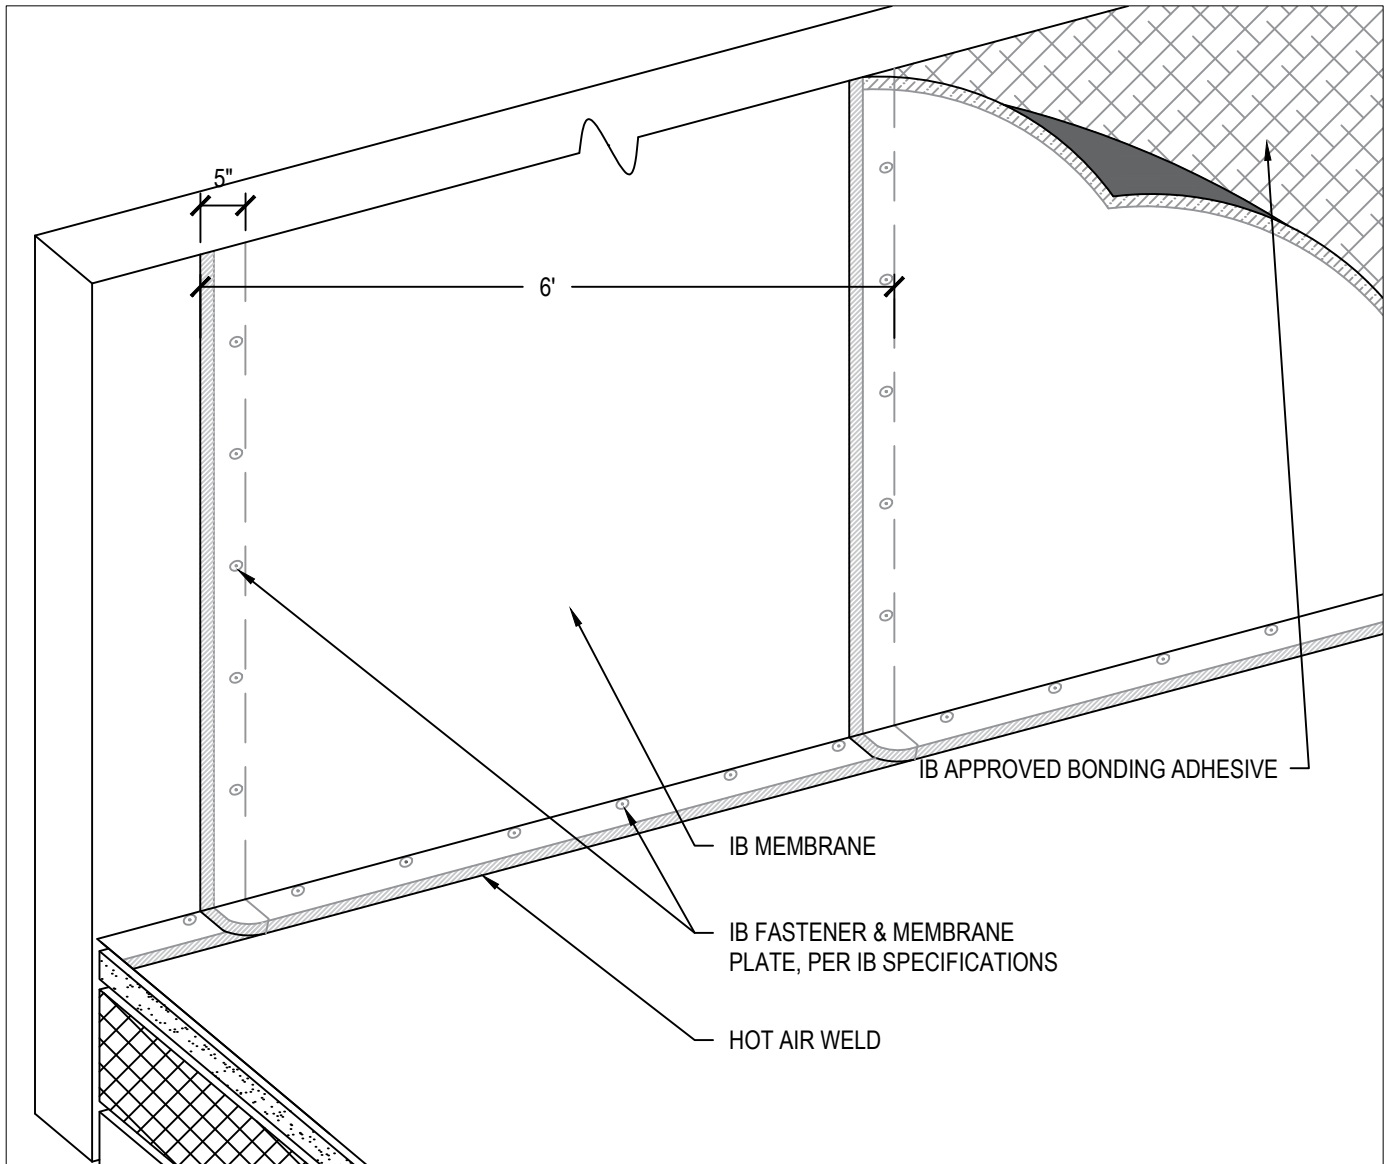

**NOTES:**

1. ADHERED WALLS: INSTALL MEMBRANE IN IB VERTIBOND ADHESIVE ADDING NOMINAL RATE OF 1 GAL. PER 60 SQ. FT. NET INSTALLED COVERAGE (50% TO SUBSTRATE ALLOW TO DRY WITH REMAINING 50% TO BACK OF SHEET, INSTALL WHILE TACKY)
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**

**NEW CONSTRUCTION - FULLY ADHERED**

- 1/2" PLYWOOD, 7/16" OSB, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

**FULLY ADHERED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS**

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, OR 7/16" OSB.

Scale:

NTS

Detail Name:

**Adhered Tall Wall**

Detail Number:

**WD - 02**


Submitted By:

Address:

Telephone:

Project:

Address:

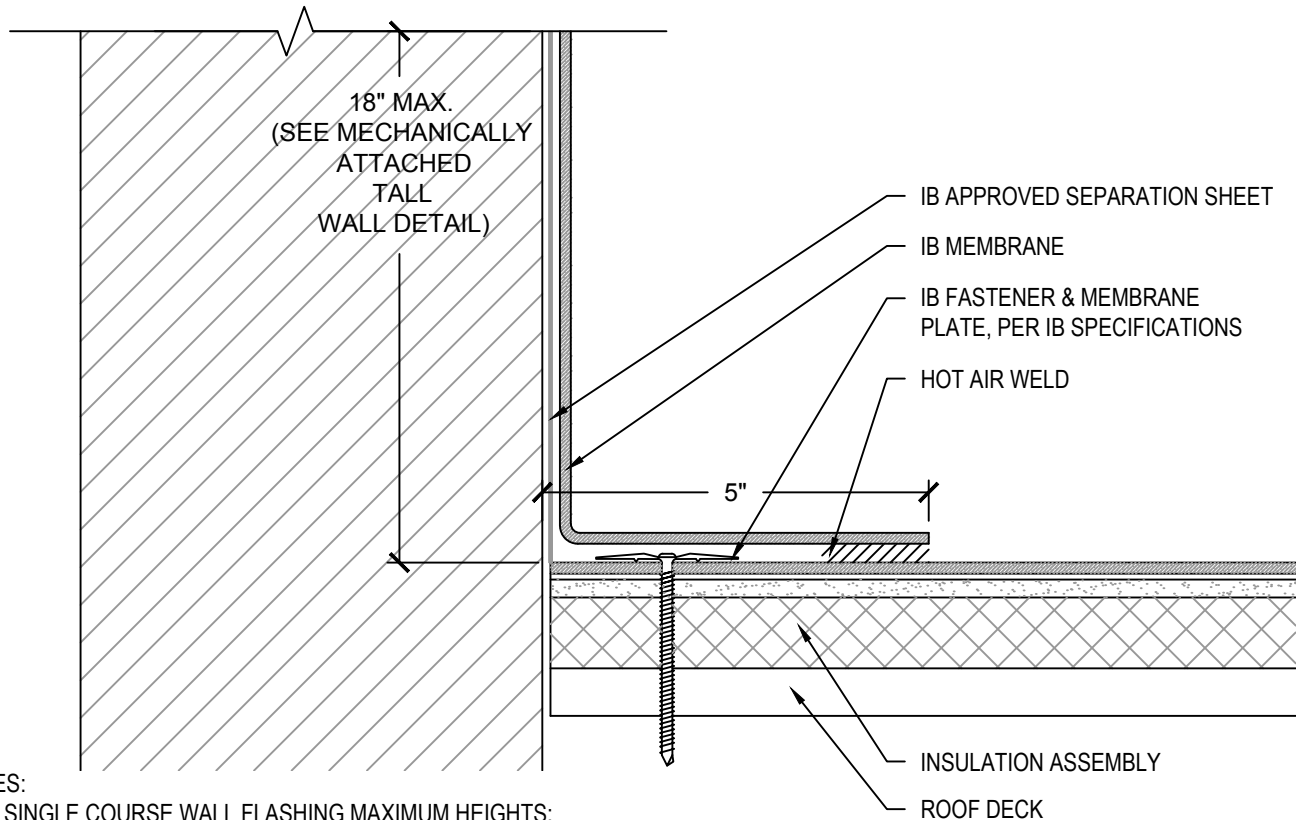

**NOTES:**

1. SINGLE COURSE WALL FLASHING MAXIMUM HEIGHTS:
  - A. 18" FOR MECHANICALLY ATTACHED FLASHINGS.
  - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO MECHANICALLY ATTACHED TALL WALL DETAILS.
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. SEALANTS AND CAULKING REQUIRE PERIODIC OWNER MAINTENANCE.
4. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**


**NEW CONSTRUCTION - MECHANICALLY ATTACHED**

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

**MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS**

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

|                                         |                                                   |                                  |
|-----------------------------------------|---------------------------------------------------|----------------------------------|
| Scale:<br>NTS                           | Detail Name:<br><b>Mechanically Attached Wall</b> | Detail Number:<br><b>WD - 03</b> |
| Submitted By:<br>Address:<br>Telephone: |                                                   | Project:<br>Address:             |

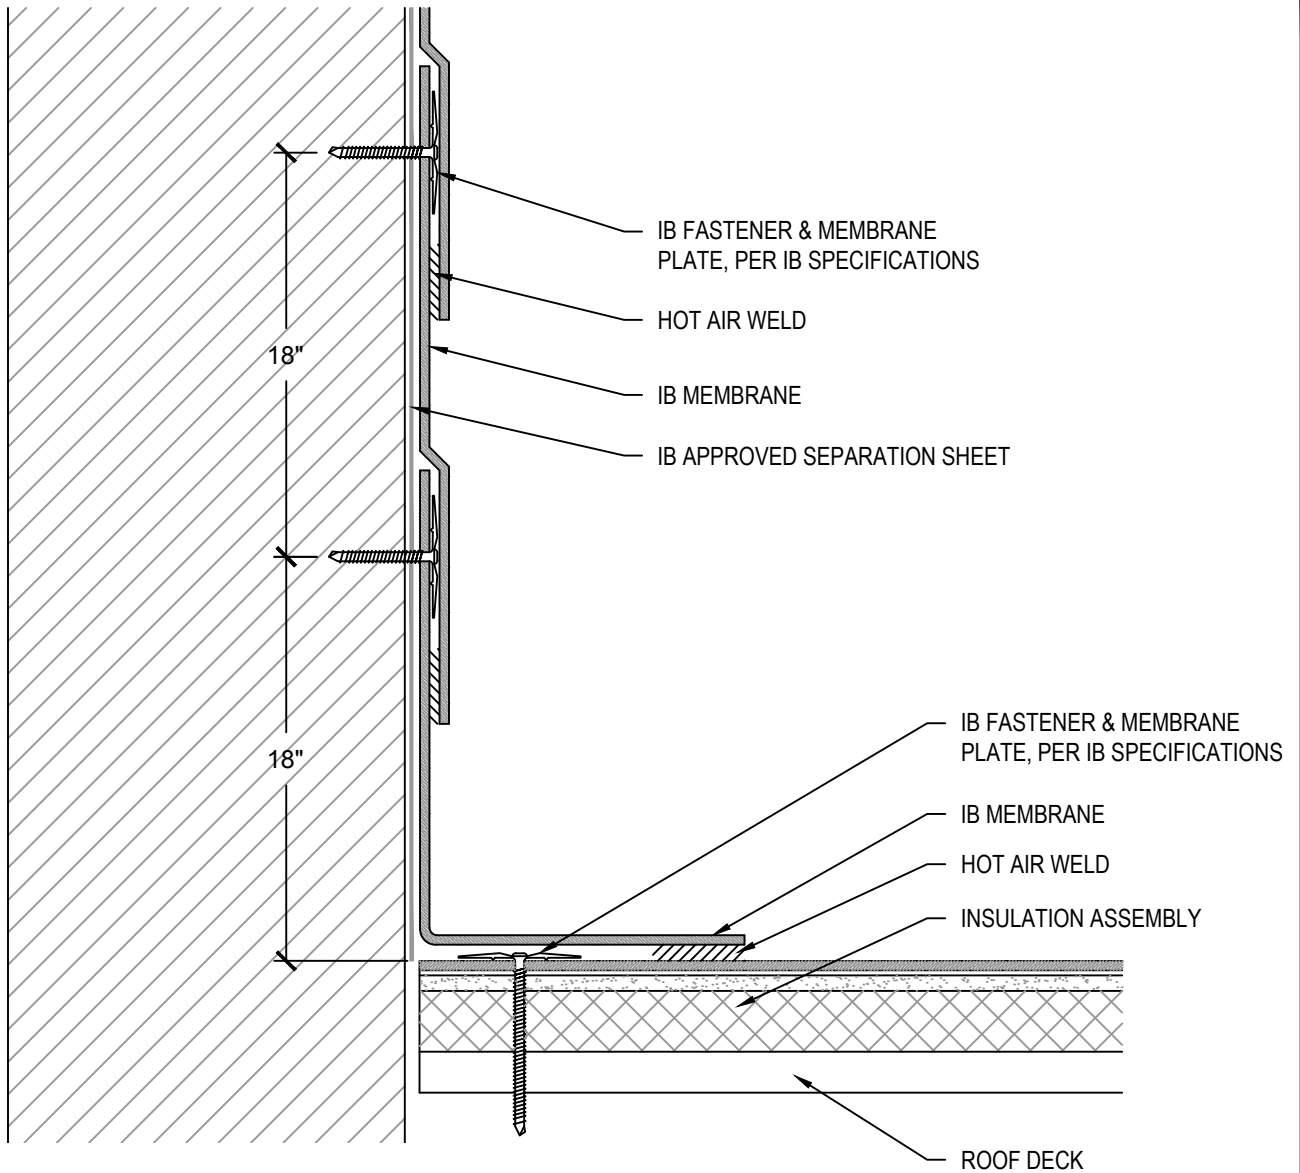

**NOTES:**

1. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**

NEW CONSTRUCTION - MECHANICALLY ATTACHED

- 1/2" PLYWOOD, 7/16" OSB, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

Scale:

NTS

Detail Name:

**Mechanically Attached Tall Wall - Standard Lap**

Detail Number:


**WD - 04**

Submitted By:

Address:  
Telephone:

Project:

Address:

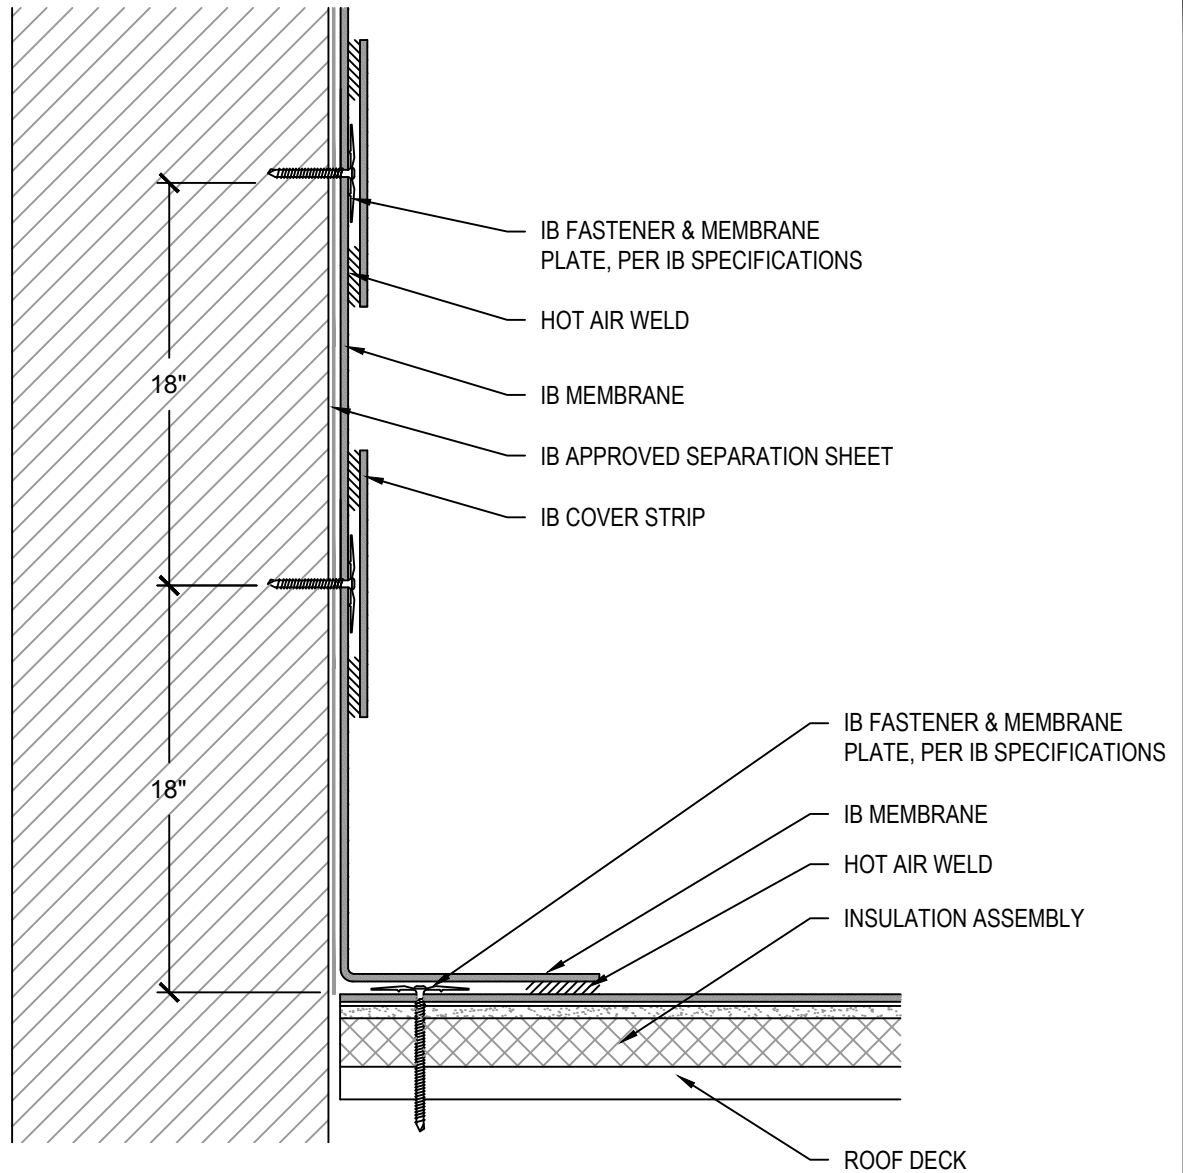

**NOTES:**

1. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**

**NEW CONSTRUCTION - MECHANICALLY ATTACHED**

- 1/2" PLYWOOD, 7/16" OSB, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

**MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS**

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

Scale:

NTS

Detail Name:

**Mechanically Attached Tall Wall - Cover Strip**

Detail Number:


**WD - 05**

Submitted By:

Address:  
Telephone:

Project:

Address:

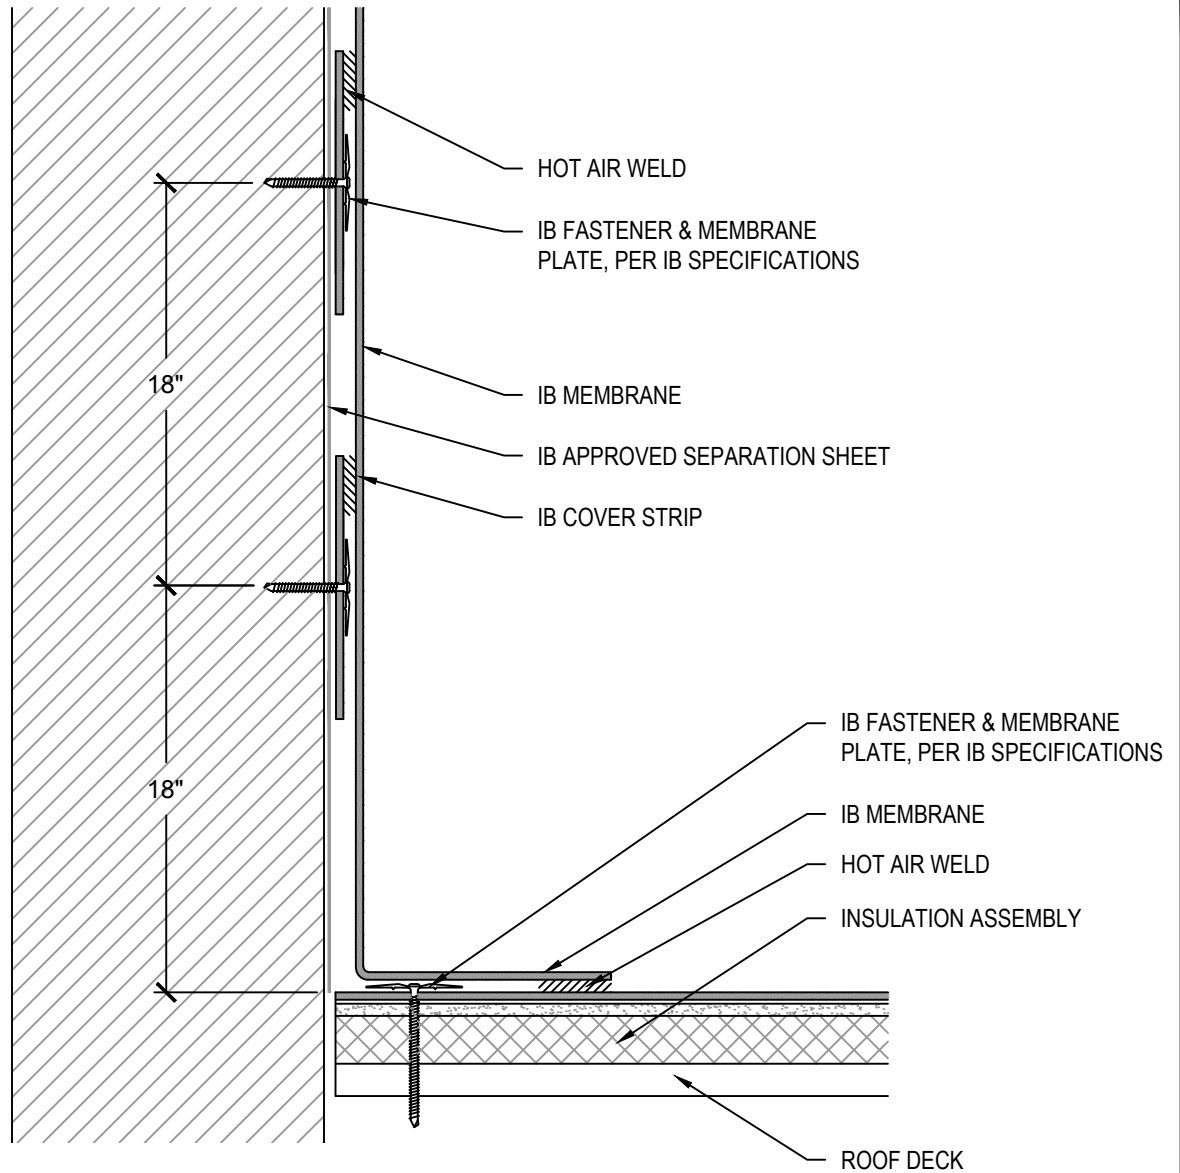

**NOTES:**

1. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**

NEW CONSTRUCTION - MECHANICALLY ATTACHED

- 1/2" PLYWOOD, 7/16" OSB, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

Scale:

NTS

Detail Name:

**Mechanically Attached Tall Wall - Reverse Cover Strip**

Detail Number:


**WD - 06**

Submitted By:

Address:  
Telephone:

Project:

Address:

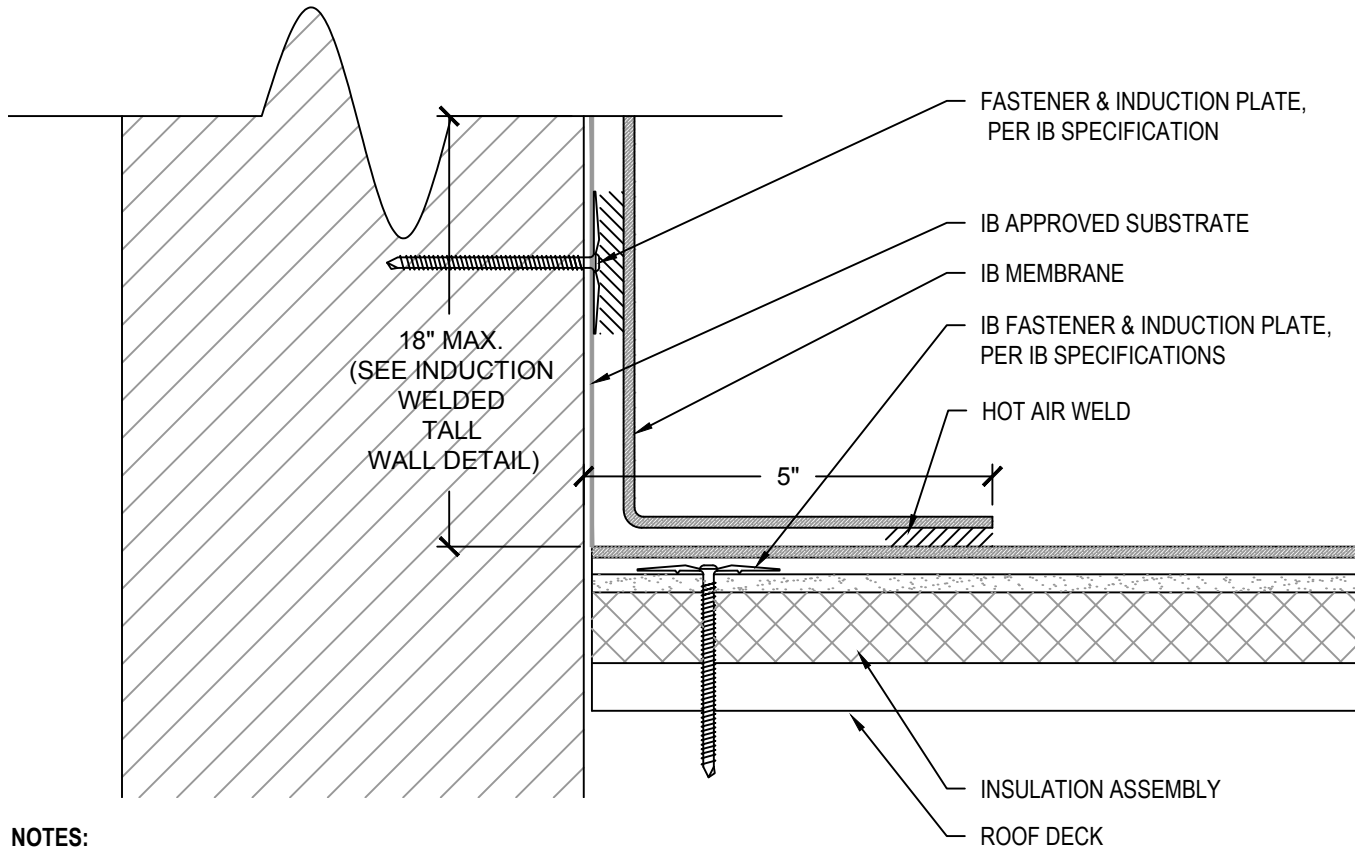

**NOTES:**

1. SINGLE COURSE WALL FLASHING MAXIMUM HEIGHTS:
  - A. 18" FOR INDUCTION WELDED FLASHINGS.
  - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO INDUCTION WELDED TALL WALL DETAIL.
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. SEALANTS AND CAULKING REQUIRE PERIODIC OWNER MAINTENANCE.
4. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**


NEW CONSTRUCTION - INDUCTION WELDED

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

INDUCTION WELDED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/4" APPROVED GYPSUM COVER BOARD

|                                                |                                                                                                                          |                                                                                                              |
|------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------|
| <b>Scale:</b><br>NTS                           | <b>Detail Name:</b><br><div style="text-align: center; font-weight: bold; font-size: 1.2em;">Induction Welded Wall</div> | <b>Detail Number:</b><br><div style="text-align: center; font-weight: bold; font-size: 1.2em;">WD - 07</div> |
| <b>Submitted By:</b><br>Address:<br>Telephone: |                                                                                                                          | <b>Project:</b><br>Address:                                                                                  |

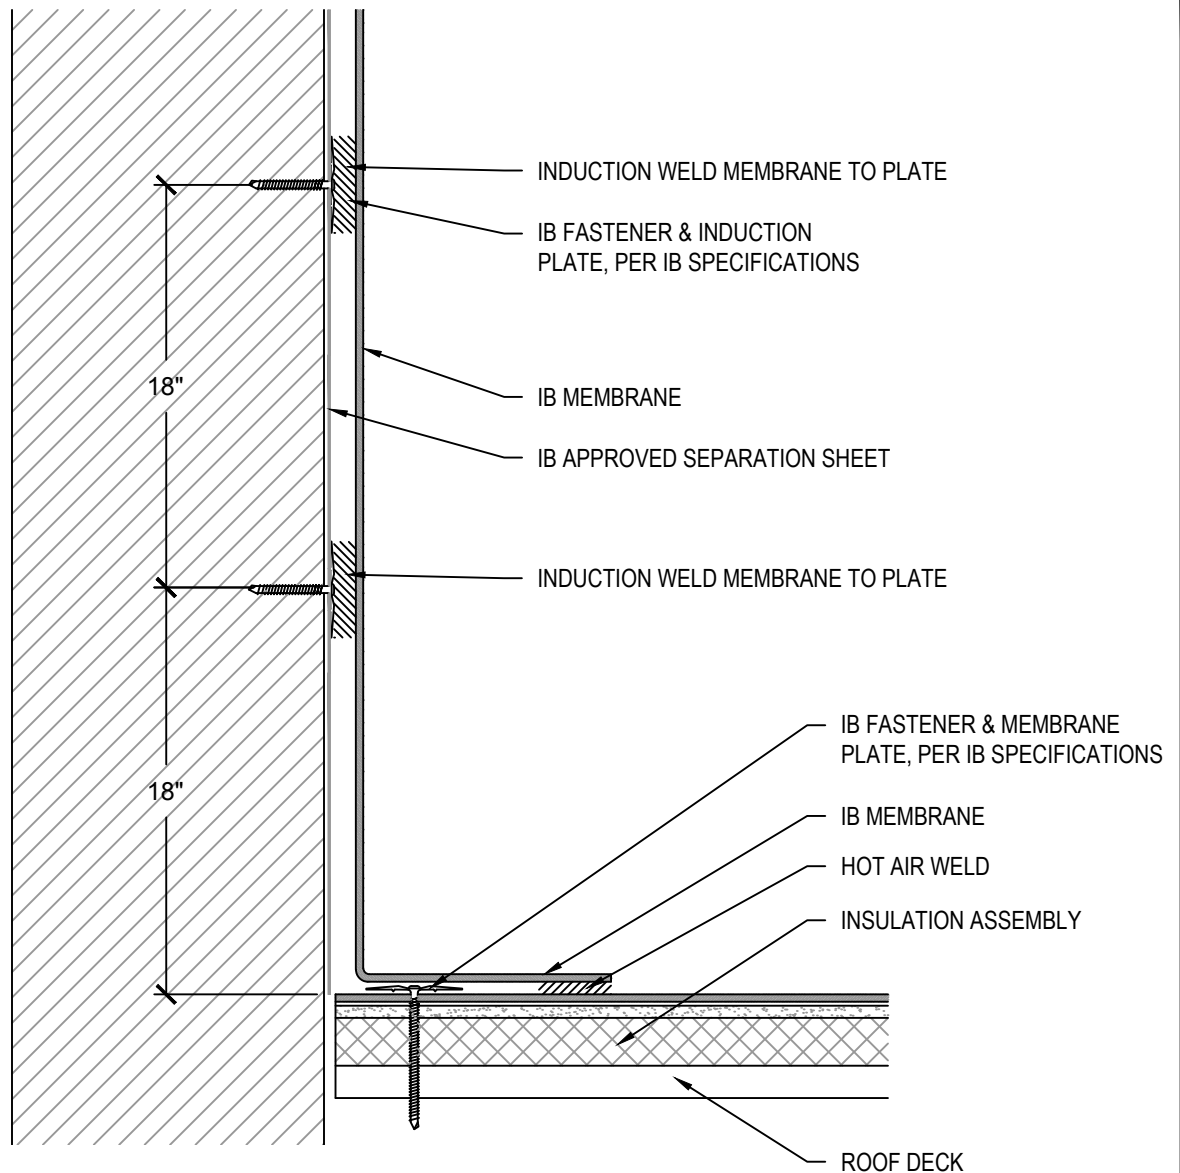

**NOTES:**

1. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND WALL TERMINATIONS

**APPROVED SUBSTRATE / SEPARATION:**

NEW CONSTRUCTION - INDUCTION WELDED


- 1/2" PLYWOOD, 7/16" OSB, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

INDUCTION WELDED RECOVER OVER APPROVED WALL AND BASE FLASHINGS FULL SEPARATION REQUIRED WITH MINIMUM 1/4" APPROVED GYPSUM COVER BOARD

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

|                                         |                                                   |                                  |
|-----------------------------------------|---------------------------------------------------|----------------------------------|
| Scale:<br>NTS                           | Detail Name:<br><i>Induction Welded Tall Wall</i> | Detail Number:<br><i>WD - 08</i> |
| Submitted By:<br>Address:<br>Telephone: |                                                   | Project:<br>Address:             |



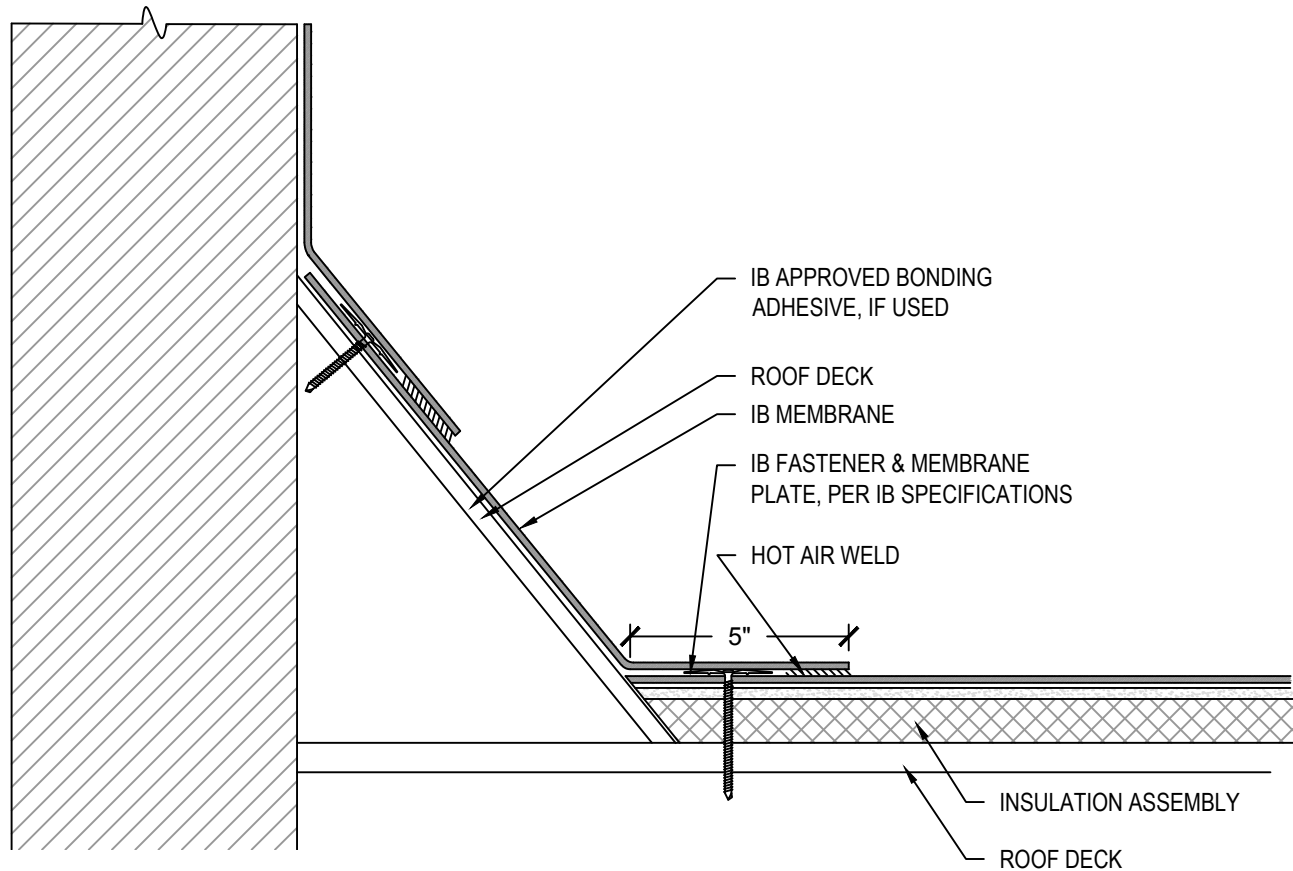

# NOTES:

1. SINGLE COURSE WALL FLASHING MAXIMUM HEIGHTS:
  - A. 18" FOR MECHANICALLY ATTACHED FLASHINGS INDUCTION WELDED OR 60" FOR FULLY ADHERED FLASHINGS
  - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO APPLICABLE TALL WALL DETAIL.
2. ADHERED WALLS: INSTALL MEMBRANE IN IB VERTIBOND ADHESIVE ADDING NOMINAL RATE OF 1 GAL. PER 60 SQ. FT. NET INSTALLED COVERAGE (50% TO SUBSTRATE ALLOW TO DRY WITH REMAINING 50% TO BACK OF SHEET, INSTALL WHILE TACKY)
3. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
4. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS.

## APPROVED SUBSTRATE / SEPARATION:

NEW CONSTRUCTION - FULLY ADHERED, INDUCTION WELDED, AND MECHANICALLY ATTACHED

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS

MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET


INDUCTION WELDED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/4" APPROVED GYPSUM COVER BOARD

FULLY ADHERED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, OR 7/16" OSB

|                                         |                                 |                           |
|-----------------------------------------|---------------------------------|---------------------------|
| Scale:<br>NTS                           | Detail Name:<br><br>Canted Wall | Detail Number:<br>WD - 09 |
| Submitted By:<br>Address:<br>Telephone: |                                 | Project:<br>Address:      |

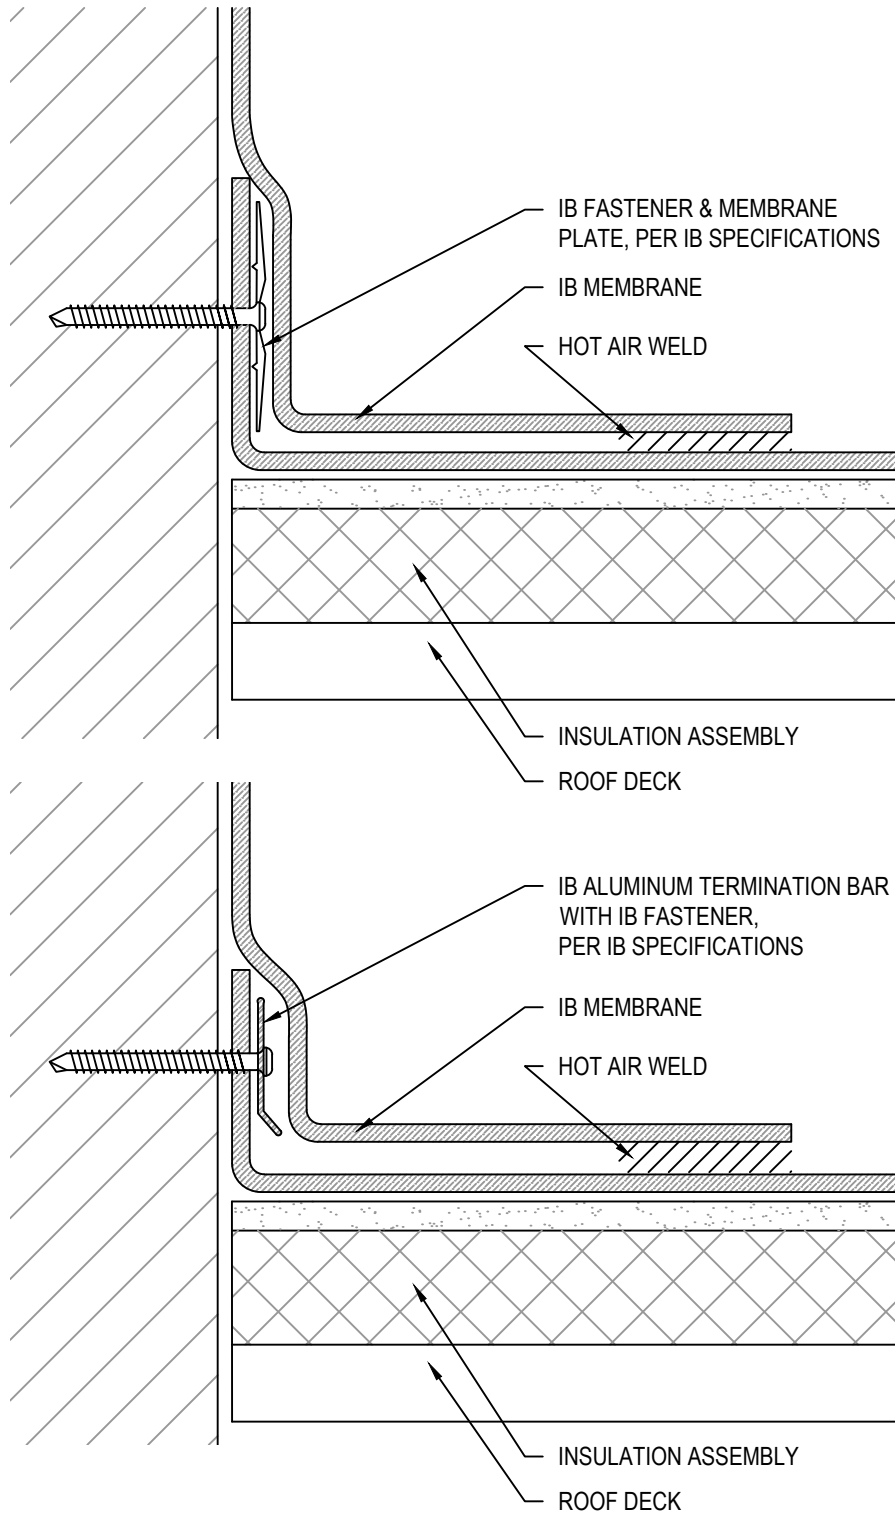

Scale:  
NTS

Detail Name:


**Alternate Membrane Termination at Walls**

Detail Number:

**WD - 10**

Submitted By:  
Address:  
Telephone:

Project:  
Address:

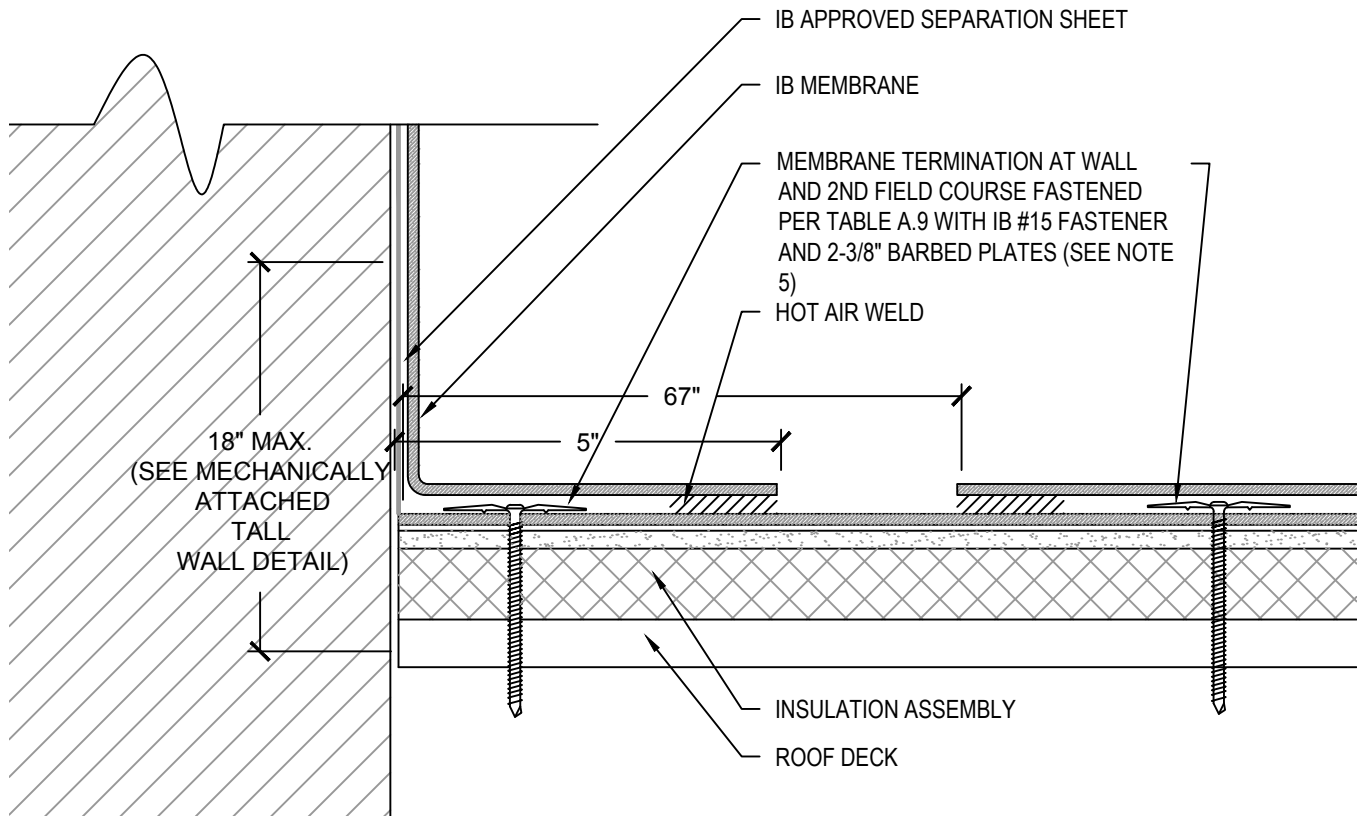

#### NOTES:

1. SINGLE COURSE BASE / WALL FLASHING MAXIMUM HEIGHTS:
  - A. 18" FOR MECHANICALLY ATTACHED FLASHINGS
  - B. FOR WALLS EXCEEDING MAXIMUM HEIGHTS, REFER TO MECHANICALLY ATTACHED TALL WALL DETAILS.
2. SECURE FLASHINGS AND METAL WORK IN ACCORDANCE WITH IB SPECIFICATIONS AND FLASHING SECUREMENT TABLE.
3. SEALANTS AND CAULKING REQUIRE PERIODIC OWNER MAINTENANCE.
4. REFER TO FT AND/OR PT DETAILS FOR APPROVED FLASHING AND PARAPET WALL TERMINATIONS
5. REFER TO TABLE A.9 FOR FASTENING SCHEDULE AND DETAIL WD-12 FOR ALTERNATE MEMBRANE TERMINATION AT WALL

#### APPROVED SUBSTRATE / SEPARATION:

##### NEW CONSTRUCTION - MECHANICALLY ATTACHED

- 1/2" PLYWOOD, 7/16" OSB, 1/2" APPROVED GYPSUM COVER BOARD, POURED / PRECAST CONCRETE, OR CEMENT BLOCK / MASONRY WALLS.

##### MECHANICALLY ATTACHED RECOVER OVER APPROVED EXISTING WALL AND BASE FLASHINGS

- FULL SEPARATION REQUIRED WITH MINIMUM 1/2" PLYWOOD, 1/4" APPROVED GYPSUM COVER BOARD, 7/16" OSB, OR APPROVED IB SEPARATION SHEET.

Scale:

NTS

Detail Name:

Membrane Termination at Wall for Full Sheet Layout

Detail Number:


WD - 11

Submitted By:

Address:  
Telephone:

Project:

Address:

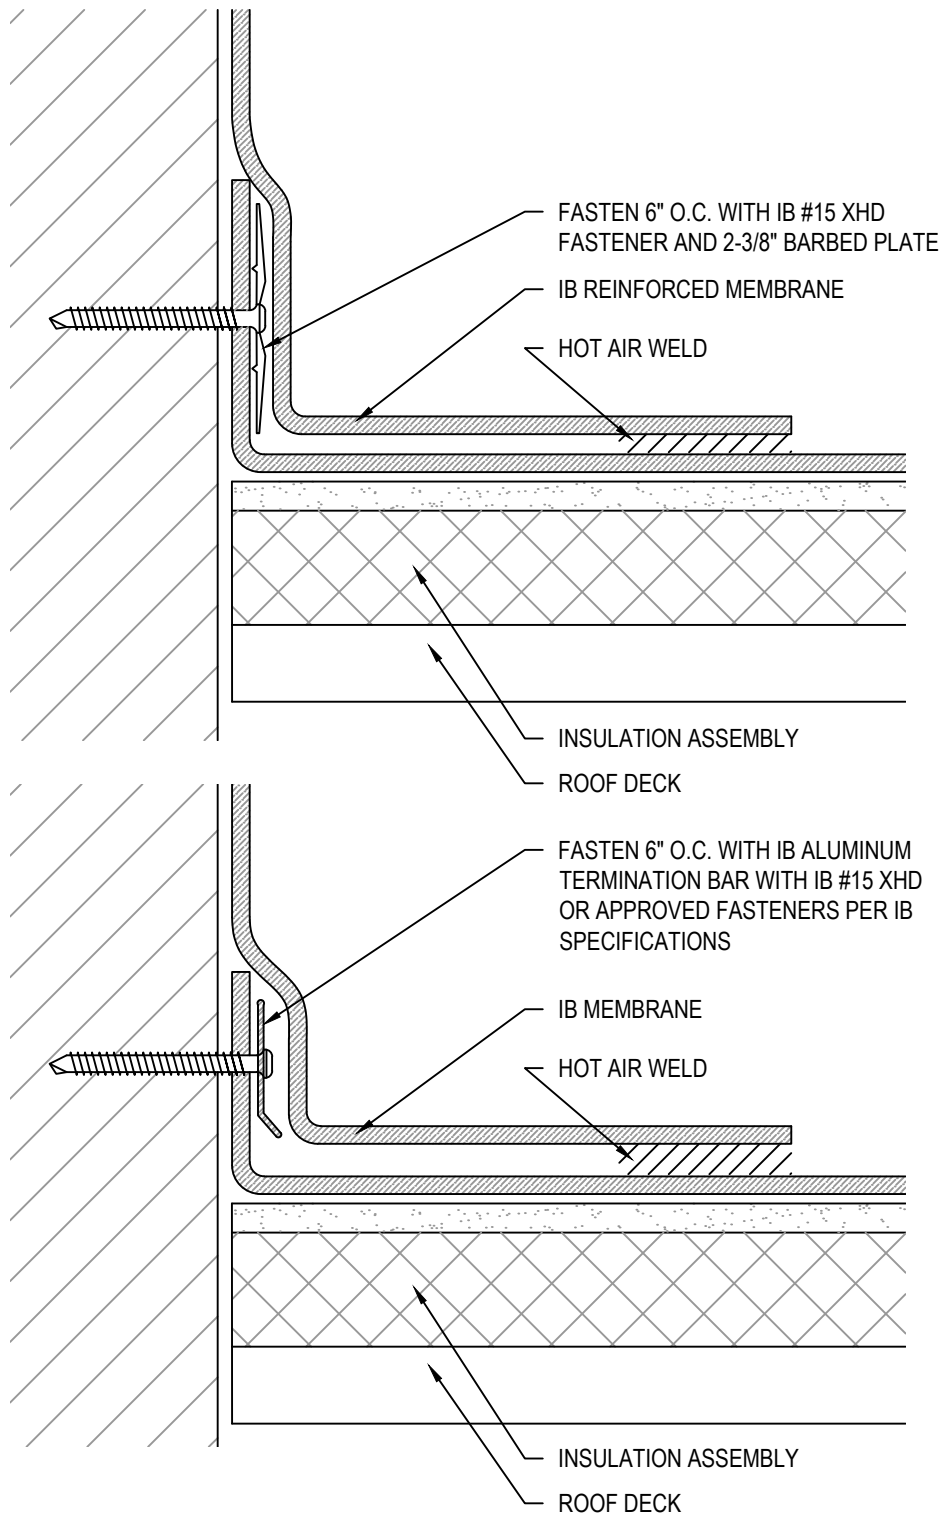

Scale:  
NTS

Detail Name:  
**Alternate Membrane Termination at Walls For Full Sheet Layout**

Detail Number:  
**WD - 12**

Submitted By:  
Address:  
Telephone:

Project:  
Address: